

Julia Bullock

From: Jill Bastow
Sent: 25 January 2024 12:40
To: Planning
Subject: FW: NYM/2023/0527, Burleigh Cottage, Brig Garth, Robin Hoods Bay Planning Response E12540- Nymnp planning reply
Attachments: HEAG081 Solid walls.pdf; Render finish 30mm approx.jpg; Damage due to render type.jpg; Deep window surround.jpg; Modern window surround.jpg; Plain window surround.jpg; Rear Wall Utility.jpg; Building Environment Marketing spreads.pdf; RFG0046.pdf
Categories: Blue Category

Please book in as public "Further response to Building Conservation Officer's Concerns".

From: neil
Sent: Thursday, January 25, 2024 11:42 AM
To: Jill Bastow <j.bastow@northyorkmoors.org.uk>
Subject: NYM/2023/0527, Burleigh Cottage, Brig Garth, Robin Hoods Bay Planning Response E12540- Nymnp planning reply

Dear Jill,

Further to your letter dated 13th Oct '23 we set out below pertinent details which will hopefully allow approval of the application.

We are pleased that the principle of sub division is accepted. It is an integral part of the scheme and allows flexibility which helps with investment and sustainability.

Apologies for the long interval but our clients, worried about the damp ingress and mould growth in the Lower Ground Floor have been awaiting the results of swab tests. These relate to the rear wall of the Utility/Store which is substantially below ground.

In terms of specific details responding to the Conservation Officers comments I set out the specific sections below:-

Lower Ground Rear Wall

The majority of this wall is below ground level. The Rear wall photo shows a line of mould growth which roughly reflects the height of external ground level that rises to be the full storey height.

This natural stone retaining wall offers little or no resistance to the passage of water/moisture into the building. The amount of moisture ingress will be season dependant but always present due to the depth below ground.

Other factors affecting the amount of moisture include the drainage which flows below the surface of Jim Bells Style. This drainage is a combined system which as the name suggests incorporates foul and surface water. It is an old system which is highly likely to leak. Our clients are actively engaging with Environmental Health and Yorkshire Water to try and resolve any leaks. This would be improve the situation but overflowing drains in times of heavy rain will always be a potential pollution issue even if leaks can be found and repaired.

At the risk of repeating myself the presence of Groundwater and whatever it contains will never be resolved.

Later I will mention the mould growth and type of spores found which may in part be due to damaged drains in the path below but also surface water runoff from the field/Paddock behind, which has over the years had stock grazing.

Because of the above, separation of the damp wall from the habitable Room must be a priority. We are aware this needs carrying out without blocking moisture movement and increasing water pressure. The system used must not offer resistance to the existing movement of moisture.

Proposed is a cavity drain membrane that allows percolation and does not rely upon adhesion. It sits on the surface and is pinned into mortar joints before a finished surface is applied within the Room.

A main feature of this form of membrane is that it allows constant 'percolation' to occur and prevents the build up of moisture and or water pressure. It is a technical membrane which has discs pressed into it which hold the membrane off the rock surface ensuring a space is maintained.

It does not affect the moisture content in the subject wall which will vary depending on the season and any drainage issues.

It is not a normal 'tanking' system that aims to prevent water ingress and often causes a build up of pressure elsewhere and can lead to a range of problems some of which are mentioned in your letter.

This sort of percolation membrane when used with the Limecrete and 'Glaxpor' floor system create a barrier between the room and the wet surfaces without blocking or resisting moisture movement. The moisture percolates down in the space between the membrane and rock surface, draining into the above described floor construction which allows natural breathability and further percolation.

As mentioned earlier, our clients have obtained laboratory test results on the mould growth. This showed various types including E.coli. They had thought there was a problem when Jackie Wallace was poorly after cleaning out that room. The test results are attached.

Insulation to External Walls inner face.

Whilst we do agree with you that the external walls have a greater efficiency when the correct breathable materials are used and the walls are dry, we believe that the correct materials used for insulating the inner face will further improve thermal efficiency and not impact negatively on the historic fabric of the building. This assertion takes into account the stone wall its self and disturbance to any internal existing features. Our proposals follow the system and ethos illustrated in the attached Historic England guide, 'Energy efficiency and Historic Buildings', section 4.

As well as the materials used this guide reiterates your concerns regarding the internal features, this is addressed later.

I believe we agree that where the outer surface has inappropriate pointing or eroded and missing pointing a correct lime based product and technique is to be employed to fully repoint.

Where the inner face is currently covered with a cement based render which a test hole shows as approx. 30mm deep it is our clients intention to remove this render back to an exposed stone face.

We have reduced the thickness of the products proposed to reduce any effect upon existing features. The attached photographs show that the main elevation windows have a deep projection from the wall, which when the removal of the render is added to it will amount to approximately 60mm. Allowing the existing surround and window board to remain.. Other windows have no surround, just a simple plastered reveal.

The item most affected will be the skirting boards. These will need removing and replacing. Where these are deemed to be historic, they will be removed and salvaged for re use. It should be noted that we will provide a schedule of skirting boards based on location with a description of likely age.

The many changes the building has seen does present a myriad of alternative sizes and shapes.

There are no fire places on the external walls so they remain as existing.

The works create an improvement for the health of the Building fabric and that this justifies the work proposed. Adjustment of internal joinery items will be kept to a minimum and catalogued for certainty.

Heating and ventilation reduces moisture content and condensation. When linked to a naturally dryer building because of the improvements proposed to the exterior walls sustainability for the future can be achieved.

The applicants are very conservation minded and have researched extensively to help the process.

We hope the above allows the conservation Officer to reconsider some elements or their concerns.

Kind regards

Neil

Link to an example of the cavity drain membrane allowing percolation:-

<https://www.newtonwaterproofing.co.uk/products-systems/products/cavity-drain-waterproofing/8mm-cavity-drain-membrane-for-basements/>

BHD Design Ltd Architectural services

The information contained in this email is intended only for the person or entity to whom it is addressed and may contain confidential and/or privileged material. If you have received this email in error please note that any review, retransmission, copying, dissemination or other use of, or taking of any action in reliance upon its contents is prohibited. If you are not an intended recipient please delete the material from any computer that may have it and contact BHD Design. Thank you for your co-operation.

The contents of an attachment to this email may inadvertently contain software viruses which could damage your computer system. We cannot accept liability for any damage which you sustain as a result of software viruses, you should carry out your own virus checks before opening any attachment.

BHD Design Ltd, Flat 1, Airy Hill Manor, Whitby, YO21 1QB Tel: 01947 604871

ENGLISH HERITAGE
PRACTICAL BUILDING CONSERVATION

BUILDING ENVIRONMENT



ENGLISH HERITAGE

ASHGATE

© English Heritage 2014

All rights reserved. No part of this publication may be reproduced, stored in a retrieval system or transmitted in any form or by any means, electronic, mechanical, photocopying, recording or otherwise without the prior permission of the publisher.

English Heritage has asserted their right under the Copyright, Designs and Patents Act 1988 to be identified as the author and editor of this work.

English Heritage
1 Waterhouse Square
138–142 Holborn
London EC1N 2ST

Published by
Ashgate Publishing Limited Ashgate Publishing Company
Wey Court East Suite 420
Union Road 101 Cherry Street
Farnham Burlington
Surrey GU9 7PT VT 05401-4405
England USA

www.ashgate.com

British Library Cataloguing in Publication Data

Practical building conservation.

Building environment.

1. Building materials—Environmental aspects.
2. Weathering of buildings. 3. Historic buildings—Conservation and restoration.

I. English Heritage.
720'.288-dc22

Library of Congress Control Number: 2001012345

ISBN-13: 9780754645580



Printed in the United Kingdom by Henry Ling Limited,
at the Dorset Press, Dorchester, DT1 1HD

To the memory of John Ashurst (1937–2008), an inspiration and friend to all the editors, whose encouragement and support was a great motivation for this new series of Practical Building Conservation.

ENGLISH HERITAGE
PRACTICAL BUILDING CONSERVATION

BUILDING ENVIRONMENT

Series Editors: Bill Martin and Chris Wood

Volume Editors: Robyn Pender, Brian Ridout, Tobit Curteis

NOTES ON VOLUME EDITORS & CONTRIBUTORS

Volume Editors & Principal Authors:

Robyn Pender, Brian Ridout, Tobit Curteis

Dr Robyn Pender is a Senior Architectural Conservator in the Building Conservation and Research Team at English Heritage, and serves on the Cathedrals Fabric Commission for England. A physicist specialising in moisture transport in building materials and systems, she studied wall-painting conservation at the Courtauld Institute of Art.

Dr Brian Ridout is also a Senior Architectural Conservator in English Heritage's Building Conservation and Research Team. He is a biologist and building scientist who has worked for many years as an international expert on timber decay and damp problems.

Tobit Curteis, who studied history of art at Warwick University and the conservation of wall paintings at the Courtauld Institute of Art, is a fellow of the International Institute of Conservation, and runs a private conservation practice specialising in environmental issues in historic buildings and monuments. He is a consultant to English Heritage, the Church Building Council and the National Trust.

Principal Contributors:

Paul Beckett, Bill Bordass, Iain McCaig, Sarah Pinchin, Nicholas Warns

Paul Beckett is a conservation surveyor who has worked on historic buildings of all periods; he has reviewed many of the volumes in this series of *Practical Building Conservation*.

Bill Bordass is a building scientist studying the technical and environmental performance of new, existing and historic buildings in operation, and has contributed to over 200 publications on energy and building performance. **Iain McCaig** is a Senior Architectural Conservator in the Building Conservation and Research Team, and studied architecture before specialising in building conservation; he is currently concentrating on issues concerning energy use in the historic built environment. **Sarah Pinchin** is an archaeologist with postgraduate training in wall-painting conservation from the Courtauld Institute of Art; her expertise includes preventive conservation and the deterioration of *in-situ* building stone. **Nicholas Warns**, a former Scholar with the Society for the Protection of Ancient Buildings, is inspecting architect for almost 90 churches in England.

The volume editors would like to take this opportunity to thank all their contributors for their help and support with this book, as well as for the information and images they have so generously provided.

Other Contributors:

Paul Baker, Sharon Cather, Caroline Cattini, Vicky Curteis, Jo Deeming, David Drewe, Steve Emery, Pedro Gaspar, Sophie Godfraind, Alison Henry, Arthur McCallum, Tracy Manning, Will Marshall, Edith Mueller, Andrew More, Geraldine O'Farrell, Peter Rumley, John Stewart, Amanda White, Clara Willett, Chris Wood

CONTENTS

The Practical Building Conservation Series	v
About This Book	vii
Using These Books	viii
INTRODUCTION	1
The Building Environment.....	3
The Building Itself.....	11
The Building Envelope.....	13
Failure of the Envelope.....	14
BUILDING SCIENCE	17
Conservation of Energy	19
Understanding Failures.....	32
Failure Under Load.....	32
Thermal Behaviour.....	35
Moisture in Building Materials	37
INTERACTIONS WITH THE ENVIRONMENT	51
The Building Envelope	53
Functions of the Building Envelope.....	54
Interior Parts of the Envelope	99
How the Envelope Modifies the Interior Conditions.....	103
The Effect of Building Occupation	109
CONTROLLING THE INTERIOR ENVIRONMENT	113
Environments for Users	115
Ventilation.....	117
Heating	121
Cooling	128
Lighting	131
Service Supplies	139

DETERIORATION & DAMAGE	145
Environmental Deterioration.....	147
Deterioration of Materials.....	149
Deterioration of the Envelope.....	161
ASSESSING THE BUILDING ENVIRONMENT	211
Environmental Assessment.....	213
Background Research.....	218
Building Performance Surveys.....	221
Specialist Investigations.....	256
DIAGNOSIS.....	309
CARE & REPAIR	325
Day-to-Day Care	327
Treatment & Repair	350
Dealing with Persistent Issues.....	351
Planning Interventions	354
Interventions on the Envelope.....	362
Modifying the Interior Environment.....	408
Assessing Interventions.....	443
SPECIAL TOPICS.....	445
Buildings & Human Health.....	447
Dealing with Disasters.....	461
Improving Energy & Carbon Performance	503
GLOSSARY.....	601
INDEX	629
ACKNOWLEDGEMENTS & PICTURE CREDITS.....	647

THE PRACTICAL BUILDING CONSERVATION SERIES

v

This series of *Practical Building Conservation* technical handbooks supersedes the original five volumes written by John and Nicola Ashurst, and published in 1988.

The series is aimed primarily at those who look after historic buildings, or who work on them. The ten volumes should be useful to architects, surveyors, engineers, conservators, contractors and conservation officers, but also of interest to owners, curators, students and researchers.

The contents reflect the work of the Building Conservation and Research Team, their colleagues at English Heritage, and their consultants and researchers, who together have many decades of accumulated experience in dealing with deteriorating building materials and systems of all types. The aim has been to provide practical advice by advocating a common approach of firstly understanding the material or building element and why it is deteriorating, and then dealing with the causes. The books do not include detailed specifications for remedial work, neither do they include a comprehensive coverage of each subject. They concentrate on those aspects which are significant in conservation terms, and reflect the requests for information received by English Heritage.

Building conservation draws on evidence and lessons from the past to help understand the building, its deterioration and potential remedies; this encourages a cautious approach. New techniques, materials and treatments often seem promising, but can prove disappointing and sometimes disastrous. It takes many years before there is sufficient experience of their use to be able to promote them confidently. Nonetheless, understanding increases with experience and building conservation is a progressive discipline, to which these books aim to contribute.

The volumes also establish continual care and maintenance as an integral part of any conservation programme. Maintenance of all buildings, even of those that have deteriorated, must be a priority; it is a means of maximising preservation and minimising costs.

Most of the examples shown in the books are from England: however, English Heritage maintains good relations with conservation bodies around the world, and even where materials and techniques differ, the approach is usually consistent. We therefore hope the series will have a wider appeal.

Dr Simon Thurley
Chief Executive, English Heritage

ABOUT THIS BOOK

Any book that tries to deal with the vast topic of ‘the building environment’ must necessarily cover a great deal of ground, from the weather, the physics of heat and moisture, and the basics of architecture and engineering, to the building's use and the maintenance and repair of complex materials and systems.

Building Environment is the product of the many years spent observing buildings by the volume editors and their contributors: buildings of all kinds, modern as well as traditional in construction, in all uses and under all conditions. It presents a comprehensive overview of building performance, and aims to equip anyone responsible for a building's care with sufficient knowledge to be able to recognise fundamental problems, and to either confidently deal with those that are straightforward themselves or successfully delegate those that are more difficult to specialists.

Many patterns of deterioration appear repeatedly, and familiarity with these patterns makes it possible to recognise and even predict common causes of problems, such as the inevitable blocked gutters and drains. Even so, every building environment is essentially unique, and the underlying causes may not always be as they first seemed. We therefore aim to steer readers away from ‘symptoms-led’ thinking: the same patterns of deterioration can arise from many different problems, and it is important to always approach the situation with an open mind. This is why the book is structured to present a coherent and logical picture of first what the building environment is, then how it works, how it fails, and finally how problems can best be remediated.

After a short **Introduction**, the **Building Science** chapter describes the physical processes that explain the many links between the building and its environment. **Interactions with the Environment** shows how these links affect the way building envelopes are designed to work, and the impact of their surroundings. The role played by the building occupants – particularly when trying to adjust the interior conditions – is covered in **Controlling the Interior Environment**. **Deterioration & Damage** looks first at the environmental degradation of individual building materials, before proceeding to consider how the envelope as a whole can fail. **Assessing the Building Environment** covers the actions needed to understand how a particular building is functioning and how it is failing, including specialist investigations such as environmental monitoring. A short chapter discussing approaches to **Diagnosis** is followed by **Care & Repair**, which introduces the various maintenance and remedial works designed to address environmental problems. Finally, the **Special Topics** at the end of the book address three important issues associated with the building environment: human health; disasters such as floods and fires; and reducing energy use and carbon emissions.

At times the conclusions we have drawn will be familiar to most readers, at others they may be at variance with accepted wisdom; but we have taken the decision to contest familiar notions which we have good reason to believe to be wrong. Too many problems can be traced back to the repetition of misconceived ideas about how building environments operate.

The audience for this volume of *Practical Building Conservation* is certain to be diverse: not only architects and surveyors with many years of experience dealing with historic buildings, but also students, building managers and homeowners who wish to keep their houses in the best possible condition. For this reason a good deal of introductory material is included; we hope that this will prove helpful even to experienced readers when they need to explain to their clients and colleagues exactly how building envelopes work.

USING THESE BOOKS

For accessibility and ease of use, the information given in the text has not been footnoted, and rather than references, short lists of further reading are given at the end of the appropriate chapters. References to other sections within the text are given in **bold**, and references to other publications in *bold italics*.

Links to other books in the *Practical Building Conservation* series are indicated throughout the text by the relevant volume symbol, showing that more information on the topic will be found in that volume.

- Conservation Basics **→BASICS**
- Concrete **→CONCRETE**
- Earth, Brick & Terracotta **→EARTH & BRICK**
- Glass & Glazing **→GLASS**
- Metals **→METALS**
- Mortars, Renders & Plasters **→MORTARS**
- Roofing **→ROOFING**
- Stone **→STONE**
- Timber **→TIMBER**

Although every attempt has been made to explain terms as they first occur in the text, a glossary has also been included, and this can be found just before the index.

INTRODUCTION



INFLUENCES ON THE BUILDING

THE EXTERIOR ENVIRONMENT

The primary influence on a building is always the environment to which it is exposed. This is typically very complex, since it includes not only the weather, but perhaps also pollution, runoff patterns, the water table, ground movements and many other factors of this type. Every building environment will depend to some extent on the local terrain, and crucially on the way the surrounding land is being used.

The exterior environment has no predefined geographical limit, but extends out as far as any factor that might be affecting the building condition. In some circumstances this could be quite considerable distances: for example, winds can carry sea salts far inland, which means that an assessor trying to understand a problem related to chlorides may be forced to take the maritime environment into account, even though the structure may be some way from the coast.

The building itself will alter the exterior environment in its near vicinity, such as windiness or runoff. To try to understand patterns of complex environmental problems (for example, storm damage, pollution, flooding or traffic vibration), the position, construction and even the materials of the building will need to be taken into account.

As a result, the exterior environment of every building will always be unique.

COMPONENTS OF THE EXTERIOR ENVIRONMENT

AIR QUALITY

The air may contain gases and particulates – ‘pollutants’ – able to interact adversely with building materials. Pollutants can be in the form of particles, droplets of liquid or gases, and may be ‘primary pollutants’ emitted directly into the air by some process such as volcanic eruption or combustion; or ‘secondary pollutants’, which will form when two or more primary pollutants interact.


WEATHER

‘Weather’ is the term used to describe the state of the local atmosphere: that is, hot or cold, wet or dry, calm or stormy, clear or cloudy (‘climate’ is the term used for the average atmospheric conditions over longer periods of time).

The components of the weather that have the most impact on buildings include rain and snow, the temperature and humidity of the air, the direction, strength and gustiness of the wind, and the patterns of sunlight. These all will vary locally and according to exposure, and may well have different impacts on different parts of the building.

Condensation on surfaces

Condensation on cold surfaces may collect to form liquid water. If the surface is of sufficiently low permeability (glass or metal, for example, or as here, polished marble), the water may run down the surface.

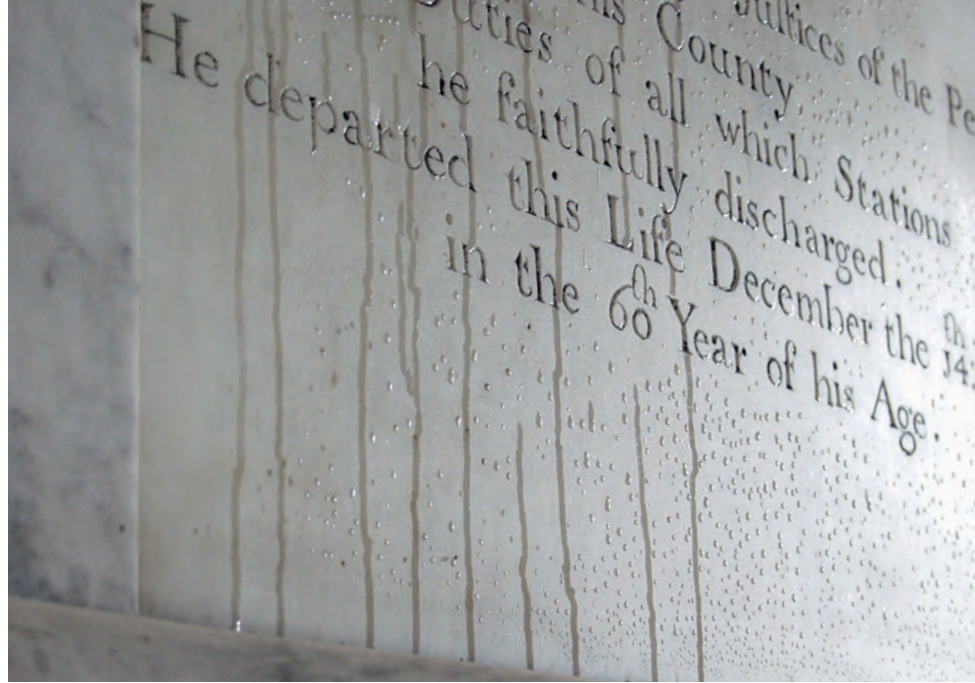

CONDENSATION & EVAPORATION

In almost every collision a molecule of water vapour makes, whether with another water molecule, or some other molecule in the air, or a surface, it will lose a little of its energy, until eventually it may be left with too little energy to break away again the next time it collides. A molecule which can no longer break away is said to have 'condensed'.

The more water molecules there are in the air, the more likely they are to collide, losing so much energy that they are forced to condense. If the vapour pressure of air near a surface is very high, eventually the surface may be covered in a film of liquid water: that is, by 'condensation'.

The colder the surface, the more energy the vapour molecules will lose each time they collide with it, so condensation is more likely on a cool surface. How cold the surface would have to be to cause a film of condensation depends on the air's absolute humidity and temperature (that is, on the vapour pressure). The vapour pressure can be used to calculate a 'dew-point temperature' [DPT]; if a surface exposed to air at that vapour pressure drops below this temperature, then water will begin to condense onto it.

Condensation is not a permanent state. A condensed water molecule will absorb heat energy from the surface and from the air, and occasionally from vapour molecules colliding with it. Eventually it may gain enough energy to break free of the surface once more: that is, to 'evaporate'. Heating a surface will cause some of the water molecules condensed upon it to evaporate again.

SATURATION & RELATIVE HUMIDITY

Returning for a moment to the image of an imaginary box of air, it is easy to see that if more water molecules are added to the box, eventually there will come a point where the number of water molecules condensing exactly equals the number of molecules evaporating: beyond this point, adding more water molecules to the air will simply cause the same number of molecules to condense out. The vapour pressure therefore remains steady, and the air is said to be 'saturated': that is, it is holding as much moisture as it possibly could at that temperature.

If the number of water molecules in the imaginary box were kept constant, but the air was heated, each molecule would have more energy to lose before it would be forced to condense: in other words, hotter air can hold more water molecules.

If there is a source of liquid water in a sealed container, the air in the container will take up water molecules by evaporation until the air is saturated. This can take some time, depending on the size of the container and the surface area of the source (the greater the surface area, the faster the evaporation).

Free air is rarely saturated, but instead will be holding only a fraction of the water molecules it could potentially hold. The actual extent of saturation is usually expressed as a percentage, and is called the 'relative humidity' [RH] (relative to saturation, in other words). By definition, the RH of saturated air is 100 %, so air at 50 % RH is holding half of the number of water molecules it potentially could hold at that temperature. Air with an RH of 50 % at 25°C will be holding much more moisture (that is, it will have a much higher AH) than air of 50 % RH at 15°C.

Condensation in voids


Because so very few water molecules are needed to saturate air, if the air in a void or hollow exposed to some sink of liquid water is allowed to equilibrate, its relative humidity will reach 100 % no matter how small that sink of moisture may be. In a closed container even a single drop of water will be ample to cause the air within to saturate: the condensation in these bottles shows that each is at 100 % RH, regardless of the quantity of liquid water present.

For this reason, measuring the relative humidity in a void in a wall can only show that the wall is dry or that it has some moisture within it: it cannot indicate how much moisture is actually present.



FUNCTIONS OF THE BUILDING ENVELOPE

To determine how a building envelope might be operating, a clear picture must be developed of the purpose and action of each of its components, of how they work together as a whole, and of how the ensemble interacts with the exterior and interior environments. Even apparently decorative elements often have functional purposes, which must be understood if repairs and alterations are not to endanger the operation of the envelope.

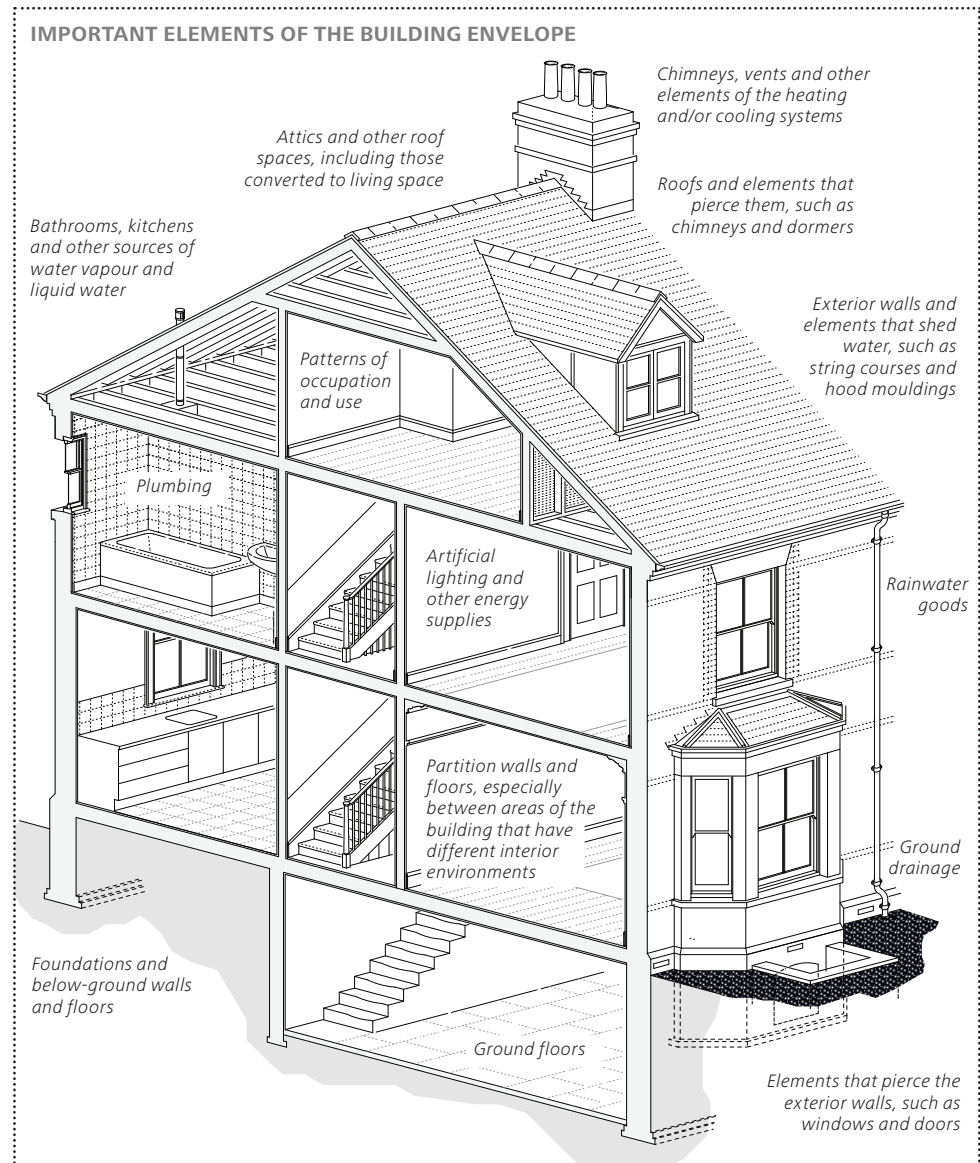

The building envelope

Every building envelope is unique. It will be composed of elements deliberately intended to serve a weatherproofing function (such as the roof and exterior walls), elements intended to control interior conditions (such as the fireplaces and other heating systems), and elements which are primarily intended to serve other purposes, but which will still have a strong impact on the interior environmental conditions (such as interior partitions and plumbing). Even apparently minor elements such as wallpapers can have a significant effect on the envelope's condition and behaviour.

KEEPING THE BUILDING DRY

In any climate that is not extremely arid, the fundamental demand on any building envelope is that it should be able to handle water. This function is critical to the way the building envelope is detailed and constructed.

Water meets the envelope in many forms, and from many sources, of which rainfall and groundwater are the most important. Almost all the familiar detailing of buildings stems from the need to move water from these sources safely away from the fabric, and especially to keep it from penetrating to the interior.

Water can be taken up by the building fabric in different ways: absorbed as a vapour, drawn up as a liquid into the pores or through fine cracks, joints and interfaces between building elements, condensed from the air onto cold surfaces, or by a combination of any or all of these (see **Building Science**). It can then travel through the structure, driven a little by gravity and very much by the ambient conditions, especially those causing evaporation. As it moves, it will transfer heat, and it can often transport contaminants as well.

The phase in which water is found (liquid, vapour or ice) is critical to its behaviour, and will also affect building materials in different ways. Phases may be very localised, since they will depend on so many factors: not only the temperature, but also (amongst others) the flow of air across the surface, the chemical and physical nature of the material, and the nature and concentration of any contaminants.

DEALING WITH RAINWATER

Like light falling on glass, rainwater meeting the envelope can be deflected from it, absorbed and held by it, or transmitted through it, and the ways in which the building does this are a marker of how successful it is at fulfilling this primary role:

- *Deflection*

Good envelopes deflect as much rainwater as possible, by using features such as drips and overhangs. Water may be collected and channelled away in gutters and drains.

- *Absorption*

Traditional building materials such as brick, stone and lime mortar are permeable, and can absorb rainwater in surface pores, from which it can later evaporate.

- *Transmission*

Modern rainscreen building systems allow a degree of transmission, with penetrating water being collected in internal drainage systems, but in both modern and traditional systems transmission of rainwater right through the envelope is a sign of failure.

How rainwater interacts with the envelope depends on other environmental factors as well, most notably windiness, air temperature and solar radiation. The risk of failure, and therefore the need for good detailing, increases with exposure to all these factors.

Ground drains may also be used to slow or stop runoff across sloped open ground. Most are based on the 'French' drain, which American engineer Henry French developed for agricultural land. These were originally simple sloped trenches filled with gravel, set across hillsides to catch the water as it ran down; later they incorporated perforated pipes and geotextile linings to stop them silting up too quickly.

The drains around building perimeters, intended to collect and dispose of both surface runoff towards the building and rainwater from the downpipes, are usually modified French drains that direct the collected water towards a discharge point (commonly a private soakaway or a public sewer). In England, there has been a fashion for backfilling perimeter drains with coarse gravel rather than capping with clay, especially if the drainage was installed specifically to deal with moisture problems. This, however, is counter-productive, since the gravel lets water run in easily, but prevents it evaporating; it also makes maintenance difficult (see *Deterioration & Damage* and *Care & Repair*).

Protection from Capillary Rise


If a wall made of permeable materials has water at its base, it will rise up the wall to the point where the rate at which water is being removed by evaporation equals the rate at which it is being drawn up through the material. This process is governed by the permeability of the wall and the speed of evaporation, which means it is affected by the ambient conditions (the temperature, humidity, and especially the air movement), the porosity of the materials and the structure of the wall (the thickness and nature of the joints between materials being particularly important).

Although some theoretical models have suggested that in a thick homogeneous wall water could rise several metres, real buildings present a very different picture. In a brick wall with lime-mortar joints, for example, moisture almost never rises higher than one or two courses, except where the wall has been given an impermeable coating such as a cement render, which prevents evaporation. Even in the laboratory, it has proved almost impossible to make realistic walls with significant rising damp.

Capillary rise

If a sample of permeable material is exposed to a continuous source of moisture at its base, water will rise up to the point where the rate of uptake equals the rate of evaporation.

Increasing the rate of evaporation (for example, by increasing the airflow across the sample) reduces the maximum height of capillary rise, whilst partially coating the sample to reduce the evaporation will make the water rise higher. Capillary rise will also be lower in a thin wall, where the greater surface area-to-volume ratio makes evaporation more effective.

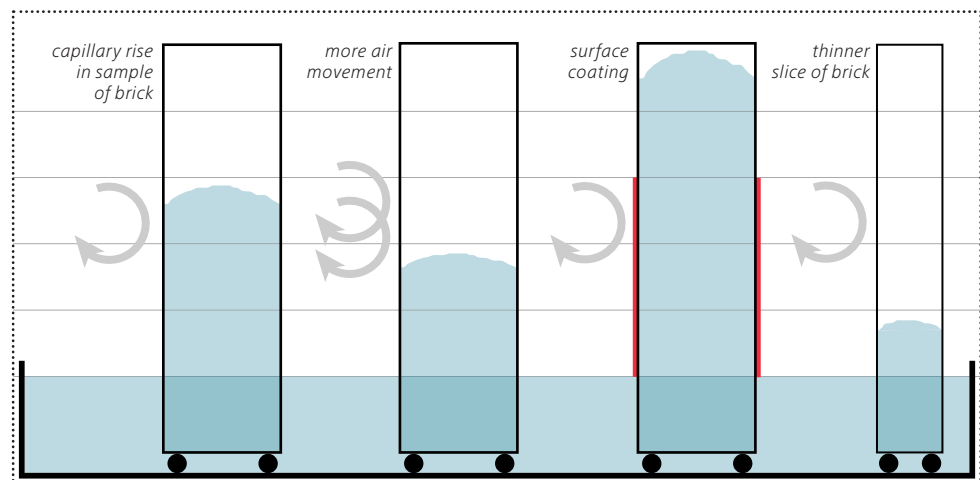

Rising damp?

The pattern of damage over the length of this run of brick masonry demonstrates why 'rising damp' – capillary rise from the water table – is unlikely to be a cause of serious moisture problems.

The classic pattern of decay and salt staining that is often attributed to rising damp is visible only on the exposed section of wall to the right, where it is clear that the true cause is water percolating down from the top of the wall. To the left, where the top of the masonry is protected, only the very base shows any sign of moisture damage, as would be expected where the source of moisture is the water table.

Serious problems from groundwater seem to have begun when sewers and mains water supplies were introduced in the mid-19th century; this was when the term 'rising damp' was invented and damp-proof coursing introduced. Leaking pipes are a much more serious source of persistent water than the water table, and the problems seem to have been exacerbated when cement renders were introduced (these prevent evaporation and so drive moisture further up the wall). Often the render will have been applied in response to a moisture problem, and thus have made the situation worse rather than better. Impermeable finishes may also make it difficult to locate the true source of the water.



One reason for the resistance of real walls to moisture rising from the base is their inherent inhomogeneity, and particularly the many interfaces between the different materials; every joint between mortar and brick will hinder the passage of water through the wall. Fundamentally, however, capillary rise is limited by evaporation, and this is far more effective in a real wall than is assumed in most theoretical models. The model most often used to calculate potential capillary rise assumes the wall to be like a bundle of fine long straws, each having a single entrance and exit. This is a reasonable analogy for water uptake in a tree, but not for building materials, where the pore structure is multi-directional and branching, with many links to surface pores through which moisture can evaporate. In practice, moisture problems from groundwater tend to occur when the wall has an impermeable finish such as a cement render that prevents the water from evaporating.

Interestingly, there is no evidence of any technology to prevent rising groundwater until the late Victorian period. The first 'damp-proof course' was a system of interlocking vitrified stoneware tiles laid through the depth of the wall a little way above ground level to deal with infiltration from poor early sewers, which tended to back up and flood cellars. This was developed and christened in 1859 by John Taylor; other builders used bituminous materials, but slate quickly became the popular choice. By the late 1870s damp-proof coursing had been incorporated into English building legislation, and although sewers and water supply systems are now much less problematic, it is still required for new build. For existing buildings, alternatives such as injected damp-proofing are sometimes used, although there is little or no evidence that these are effective (see **Deterioration & Damage**). The original cause of the problem appears to have been forgotten, and 'rising damp' has become a catch-all phrase for all moisture problems in walls, even when the water is percolating down from above.

Although the water table will not in fact be a source of problems for most types of construction, water-sensitive materials such as timber and cob will still need to be protected from ground moisture. The traditional approach has been to construct walls made primarily of these materials onto a masonry plinth made of stone or brick.

Thermal buffering


Like many medieval churches, St Botolph's, at Hardham in Sussex, has massive masonry walls. These have an extremely high thermal inertia and are therefore excellent temperature buffers. During the day, their external surfaces are warmed by the sun and the air; this heat transfers through the wall slowly, so that by evening – when the exterior conditions have begun to cool – the interior will still be warming. If the building is not heated, maximum interior temperatures will be reached well after the hottest part of the day, and although the interior will always be cooler than the exterior maxima, it will also stay warmer than the coldest exterior conditions. In other words, the interior temperatures will be both more stable and less extreme than the exterior.

In a building of this type, thermal buffering is enhanced by the small amount of surface area taken up by windows and other components of low thermal inertia.

If such a building is heated or cooled, buffering will reduce the amount of energy that must be used to achieve the desired temperatures.

Traditional buildings usually provide good thermal buffering, since both the materials and the construction have a great deal of thermal mass. Metal and glass were used sparingly, and serious thermal bridges were therefore uncommon. Radiative transfer into massive walls and floors was reduced with wall and floor coverings of timber or fabric (panelling, tapestries and carpets).

By contrast, materials with low thermal inertias are critical to modern architecture. In response, engineers have been forced to develop sophisticated ways of increasing thermal mass, such as thermal breaks, multilayered insulation systems for walls and IGUs [Insulated Glazing Units] to replace single sheets of glass in windows and curtain walls. Glass may also be covered with plastic filters to reduce radiative uptake.

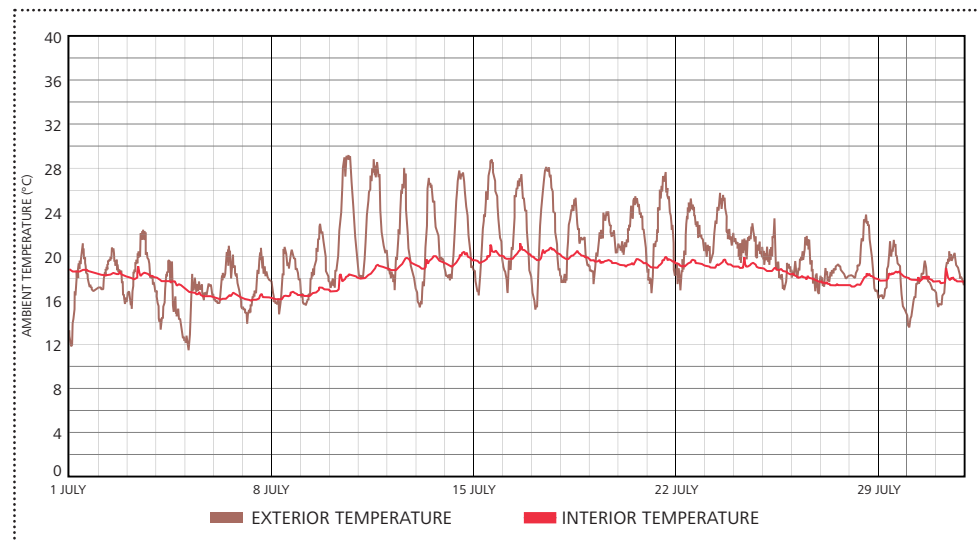

BUFFERING THE EXTERIOR HUMIDITY

The primary mechanism for humidity buffering is air exchange: buildings that are very 'leaky' tend to have internal relative humidities that closely follow those of the exterior air. The secondary mechanism is permeable materials absorbing and releasing water vapour in response to changing relative humidities. If the interior vapour pressure is constant, the fabric and the interior air will be at equilibrium, but if the vapour pressure of the air changes, then hygroscopic materials such as brick, stone, lime plaster and especially timber will respond by either taking up or giving up moisture until a new equilibrium is reached.

Every permeable building material will have its own characteristic hygroscopicity, taking up moisture from the air in a way that depends on (amongst other factors) the structure of its pore system and the presence of contaminants such as salts. Moisture absorption and desorption depends on the ambient conditions: for example, plotting a hygroscopic material's moisture content against changing ambient relative humidity generates a characteristic curve, showing the 'equilibrium relative humidity' of the material.

Some degree of existing moisture is important to the material's buffering capacity, since very dry materials absorb moisture much less effectively (just as a sponge will not absorb water when dry, but becomes very absorbent indeed once slightly wetted: the reasons for this are discussed in **Building Science**). It has been shown experimentally that an oven-dried lime plaster will absorb very little water vapour from the air, but after several months or years of exposure, even plaster in perfect condition will be holding some moisture in its pores, and will therefore be an excellent buffer. Materials such as timber will usually be holding significant amounts of moisture (as much as 15 % by weight for wood in good condition), and this acts as a sink of water when, say, a temperature increase causes the ambient relative humidity to drop. It also helps the wood to take up water vapour when the humidity rises again (that is, when the temperature drops, or wetter air enters the building).

The envelope will also have its own characteristic 'hygric mass': the way it buffers humidity will depend not only on the permeability of single materials, but on the behaviour of complex groups of materials. Discontinuities, interfaces, joints, surface finishes and coatings may all have a significant impact. For example, moisture-resistant coatings such as vinyl paints will hinder evaporation much more than they hinder moisture uptake, so painted plaster may steadily become wetter (see **Building Science**).

The average absolute humidity in the interior will be steadier, but typically slightly higher, than the exterior.

All parts of the building can contribute to the humidity buffering, including the interior and the contents such as timber furniture. The floor is one of the largest surfaces for moisture exchange; traditional solid floors, which do not incorporate damp-proof membranes but are bedded directly onto the earth or onto a permeable lime-based mortar, can account for more than half the moisture content of the fabric. So long as there is plentiful air movement and air exchange this does not damage the building, and indeed it prevents groundwater being driven up the walls.

Freeze-thaw damage

Freeze-thaw damage can occur in any wet permeable material exposed to low temperatures, but is most commonly seen in masonry. Problems may be exacerbated by the use of cement-based mortars, which trap water. The pattern of deterioration reflects not only exposure, but also the variation in the quality of the bricks or stones, since it is the weaker units that will fail. So many factors can be at work that freeze-thaw is often hard to unequivocally pinpoint as a reason for deterioration.



Indirect Damage

Many of the problems indirectly caused by temperature involve its effect on moisture. For example, cooling may lead to condensation, and wet permeable materials may break down under freezing conditions, especially if subjected to repeated cycles of freezing and thawing.

Although the precise mechanism for freeze-thaw damage is not well understood, it may be related to the bursting of water pipes in cold weather. In this case at least, it is not actually the force exerted on the walls of the pipe by the expansion of the water as it freezes that does the damage: the pipe is much too strong, and instead forces the ice crystals to grow along the pipe. This compresses the air trapped ahead of the ice front, so air pressure will build up until eventually it is sufficient to split the pipe apart at the joints. Hot-water pipes are more prone to failure than cold-water pipes, since the cold-water system often includes toilet cisterns which act as expansion valves.

Roofs that are periodically covered in thick snow face other problems. If the ceilings are not insulated and the attic space above is not very well ventilated to the exterior, the roof covering may heat up, causing the snow to slide off, which can be a risk to building elements below. The meltwater may refreeze at the eaves, causing ice dams that endanger not only the eaves and gutters, but passers-by as well.

IMPACT OF SUNLIGHT

As with temperature, sunlight can cause damage both directly and indirectly, although in this case the direct damage is usually confined to superficial changes, and it is the indirect damage – chiefly localised heating – that is able to cause the most severe problems for most building envelopes. Since exposure depends on the building and its surroundings, this can change quite dramatically through the day and the year.

Direct Damage

Although the ultraviolet component of sunlight can break down organic materials in building components, this is usually superficial. It is of most importance for decorative surfaces such as wall paintings or wallpapers that incorporate dye pigments, where the appearance can be dramatically altered by fading. Exposed timberwork will change colour, but this will not affect its strength to any significant degree. Sunlight can also break down glues and sealants such as putties and silicones, which can be a serious issue for some modern curtain-wall construction, but the degree of damage will depend on the exposure. [GLASS](#)

Indirect Damage

Solar heating can cause materials to expand and contract, and can also act as a catalyst for chemical reactions. Solar heating can cause very high vapour pressures in surface pores and inside hollow-wall construction, and this can force moisture through the wall. Sunlight exposure is also a critical factor governing the growth of plants and microorganisms in and around the building.



Sunlight damage

Many plastics are very susceptible to damage from ultraviolet light.

In this railway station roof, the translucent panels have severely discoloured. Even newer replacement panels (such as that at top left) are beginning to show signs of the same deterioration.

BUILDING ENVIRONMENT

DETERIORATION & DAMAGE: DETERIORATION OF THE ENVELOPE

Taking readings of environmental conditions with a hand-held meter

Hand-held electronic meters are now available at little cost; most will measure relative humidity and temperature, and may calculate absolute humidity and dew point. More sophisticated models may have interchangeable probes, allowing the surveyor to take readings of other environmental parameters such as air movement or pollution.

Although hand-held meters will only give spot measurements, and the readings for a single day should never be given too much weight in interpretation, they can still be a handy way to examine the overall behaviour of the building envelope, and can be used to help plan more exact investigations.



Water problems will not always be due to a problem with the building envelope, or to condensation: leaks in plumbing and heating pipes, or even in fire-protection systems, are common sources of problems.

Most assessors find it useful to map superficial decay onto elevations. Relative moisture and salt levels in walls can also be roughly mapped using resistance or capacitance moisture meters, and although the results will not be accurate, the resulting patterns may help to narrow down a hidden source of moisture. It is possible to take spot measurements of temperature and humidity, usually with hand-held meters. Although the information this gives should be approached with caution, it can be a way of making general comparisons, especially when looking at the potential effects of heating: comparisons between different internal spaces, for example; or between the exterior and interior.

Each room will need to be assessed separately, as well as considered in terms of impact on the envelope as a whole. Windows and doors must be checked not only for signs of leaking and other similar problems, but to see whether they are operating correctly.

If the likely source of moisture-related damage is still not clear, it may be necessary to look at the exterior once again, double-checking details that could be causing problems, such as the pointing, the joints between building elements (for example, around windows), and the flashings and seals.

Recent changes to the fabric (for example, the addition of carpets or tiles, or of impermeable paints or wallpapers, or the installation of a new heating system) can be a critical factor, so these must be identified. Changes in the way the building is being used are equally important, as are any alterations that have been made to the environmental management. All evidence of building services, both old and new, will need to be recorded, and the building users questioned to construct a picture of the ways the current services (such as heating) are actually being used.

Almost every aspect of the building environment has the potential to merit closer investigation and measurement as part of a building performance survey, from the slope of the surrounding ground to the structural soundness of the building elements.

CHARACTERISING THE GROUND SLOPE

If it is suspected that the ground levels are causing runoff problems, or there are subtle issues between interior and exterior ground levels, this can be checked very easily with simple tools (string, a metre rule and a level), though it does require that the surveyor has some assistance. Alternatively, professional surveying equipment can be used.




Determining relative ground levels

Top: Interior floor levels, the difference in the interior and exterior ground levels, and the slope of the ground around the building, can all be determined to sufficient accuracy for most purposes using the simplest of tools: two straight sticks or metre rulers, a tape measure, string and a builder's level, or a line level.

Bottom left: Measurements are taken relative to one point, usually inside the building, with the measurement team working outwards from there; each reading becomes the baseline for the next measurement. The results are marked onto a building plan.

Bottom right: To connect the internal and external measurements, it is usually easiest to note the height of the same window sill on the interior and exterior.

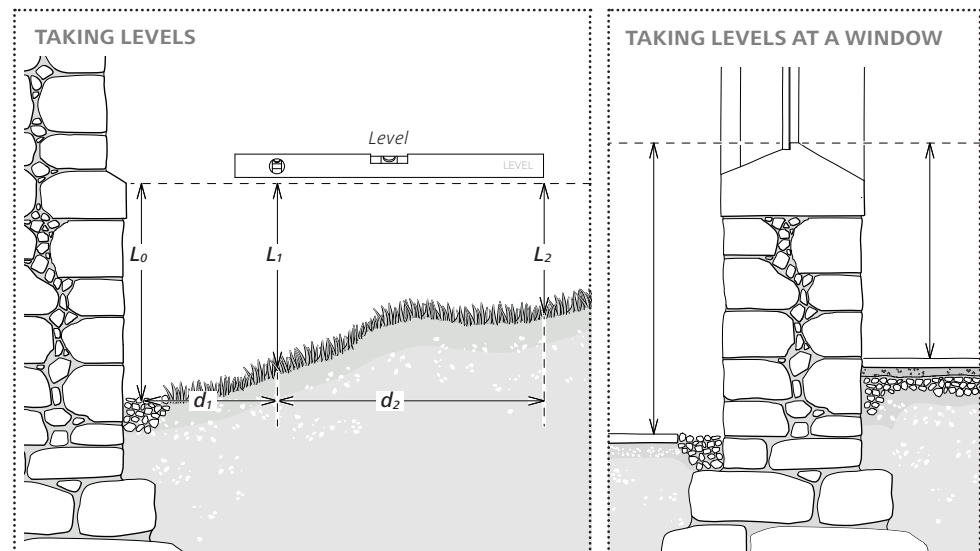

Selecting the Correct Sensors & Probes

Data is only as good as the sensors gathering it, so it is important to understand their accuracy and repeatability. Readings taken for investigating the building environment rarely need to be as accurate as (for example) readings taken for process control in factories. Repeatability of measurements taken by a single sensor, or between different sensors around the building, is much more important than accuracy.

All electronic sensors must be supplied with power, but the way in which this is provided varies. Hardwired probes generally draw their power directly from the datalogger, but radio telemetry probes are generally powered by batteries (like stand-alone loggers, these require periodic renewal; but because battery life can be transmitted along with the data, warnings can be provided to the logger when battery power is low).

Some probes – hot-wire air velocity sensors, for example – require more power than can be provided by batteries. They must therefore be supplied with electricity either directly from the mains, or from solar panels (or some other alternative source).



It is convenient to group probes into 'clusters': this not only makes installation easier, but means that the readings from the sensors are as comparable as possible.

Here, each cluster includes a thermistor reading surface temperature, and a combined relative humidity and temperature [RH&T] probe. All probes are protected from the drying and cooling effects of air movement by screens (a block of green foam in the case of the thermistors, and filters or a Stevenson screen in the case of the RH & T probes). This ensures accurate and repeatable readings.

Most monitoring begins with equipment to measure temperature and relative humidity, often together with surface temperatures. Monitoring exterior and interior microclimates is also standard, as this more than any other comparison reveals how the building envelope is working. The weather station is a particularly useful tool, combining in a single unit the measurement of exterior temperature and relative humidity, rainfall intensity, sunlight, and wind.

Structural monitoring can also be incorporated in a programme of environmental monitoring to check whether or not apparent weaknesses reflect serious problems, and whether or not these are affected by environmental parameters such as temperature or wind. This can mean monitoring ground motion, structural frame response, component response, and creep or settlement.

COMMON ELECTRONIC SENSORS USED TO MONITOR THE ENVIRONMENT

PARAMETER	TYPE OF MEASUREMENT	SENSORS	COMMENTS
AIR TEMPERATURE	Direct	Thermometers Thermocouples Thermistors Resistance sensors	Thermocouples are not reliable when used to measure temperatures close to the ambient air temperature
SURFACE TEMPERATURE	Attached sensors	Thermistors Resistance sensors	Accuracy depends on method of attachment
	Remote sensors	Infrared thermometers Infrared thermography	Readings depend on surface emissivity as well as temperature
AMBIENT HUMIDITY	Direct	Capacitance sensors Dew-point sensors	Need regular recalibration
LIGHT	Direct	Photodetector	Can measure different wavebands
	Indirect	Photodetector	Can measure different wavebands
AIR MOVEMENT	Pattern and speed of flow	Smoke tests Particle velocimetry	Air movement is very variable, so spot measurements can be particularly deceptive
	Speed of flow	Cup anemometers Hot-wire anemometers Ultrasound	The presence of probes can cause turbulence and affect the reading; this is a great problem at low speeds
AIR EXCHANGE	Indirect	Tracer gas	On-off measurement: therefore, conditions under which to monitor must be chosen carefully
	Direct	Door or window opening	Closure of window or door completes circuit May need quite complicated processing to extract both numbers of opening and closing events, and the duration of each separate event
MOISTURE CONTENT	Indirect	Resistance sensors Embedded capacitance sensors Embedded microwave-capacitance sensors	Best systems based on measuring dielectric change, but currently no totally satisfactory method, since sensor must be inserted in a drilled hole, and this changes the characteristics of the material
WATER EVENT	Direct	Strip with a simple printed electronic circuit; presence of liquid water completes circuit	Can be used to detect surface condensation or, for example, blockages in gutters Can be used to trigger an alarm
HEAT LOSS	Indirect	U-value reading with flux meter	U-value is a measurement of conductive heat loss only
AIR POLLUTION	Direct	Air pumped through analytical device	Sensor can be chosen to detect a range of pollutants, or to monitor a single pollutant to a greater accuracy

COMMON OBSERVED SYMPTOMS OF ENVIRONMENTAL PROBLEMS

AREAS OF 'DAMP'

DESCRIPTION

POSSIBLE CAUSES

ACTIONS TO SUPPORT DIAGNOSIS

MOIST PATCHES HIGH ON WALL



Source of liquid water; common causes include:

- blocked rainwater goods
- chimneys with rainwater penetration
- impermeable renders trapping moisture

May be hygroscopic salts; sources include:

- deposition of combustion products in flue
- trapped organic material in flue
- building use
- internal pollutants (such as sulphate deposits from heating)

Look for decay of embedded timbers (such as joists and lintels)

Map distribution of damage, and compare to possible building flaws

Look for possible sources of hygroscopic salts

If source is unclear, take samples from wall to determine moisture content and distribution, and salt content (look for hygroscopic salts)

CONDENSATION ON IMPERMEABLE SURFACES



Visible water beading on impermeable surfaces such as glass or metal under certain conditions; wall feels cold and damp to touch; may be damaged finishes or signs of moisture problems (such as decay for timber affected by runoff)

May be liquid water problem, with condensation as apparent or real side-effect

Unusually thin masonry walls, chilled by wind

Liquid moisture problems from other sources, including blocked rainwater goods or drains

May well be exacerbated where problems have led to wrong interventions (for example, a cement render)

Under what conditions does water-beading appear?

May be necessary to monitor environmental conditions, including surface temperature, and to understand how the heating system is being run

Map distribution of damage, and compare to possible building flaws

Assess quality of pointing and render, checking especially for fine cracks that could wick in moisture

CONDENSATION INSIDE SECONDARY GLAZING



Significant condensation on the inside of the glass, occurring regularly; runoff staining below the window; decay of timber cill and horizontal members of windows, or corrosion of horizontal members and joints of metal windows

High interior humidity (coupled with cold glass)

Insufficient ventilation to exterior, especially where wall has moisture problems

Under what conditions does condensation occur?

May be necessary to monitor environmental conditions

Look for liquid moisture problems in surrounding wall

CONDENSATION INSIDE INSULATED GLAZING UNIT ('DOUBLE' OR 'TRIPLE' GLAZING)



Failed seals (these have a limited lifespan)

Sometimes cracked glass

Seals can be tested by placing a cup containing dry ice against the glass; if the seals have failed, this will provoke condensation

If glass has cracked, look for source:

- impact
- glazing unit fits too tightly in frame, so that thermal movement causes failure

COMMON OBSERVED SYMPTOMS OF ENVIRONMENTAL PROBLEMS

NON-VISUAL SYMPTOMS

POSSIBLE CAUSES

ACTIONS TO SUPPORT DIAGNOSIS

MUSTY OR DAMP SMELL

Timber decay
Mould growth
Most common in areas with limited air circulation

Is the smell present all the time, or only after the room has been shut up?
Look for sources of water: most commonly liquid water leaks, but condensation can also be a problem (such as condensation behind impermeable insulation or membranes)

SPACE FEELS 'STUFFY'

Insufficient air exchange and/or air movement
Sources of ventilation such as windows, chimneys sealed up
Central air-conditioning system with inadequate filtering or ventilation

Is it a problem at most times, or only in certain conditions or times of the year?
Is it a problem in all rooms, or only in certain rooms?
Check airflow and air exchange, especially around doors, windows, chimneys

SPACE FEELS DRAUGHTY

Air leakage through windows, doors or chimneys
Open-plan interior: no ability to isolate spaces
Poor control systems: heating causing air currents, or pulling in colder air; heating using blowers or localised radiators; air conditioning blowing air too strongly
Large areas of glass (thermal bridging)

Is it a problem at most times, or only in certain conditions or times of the day or year?
Is it a problem in all rooms, or only in certain rooms?
Check condition of windows, doors and so on
Check airflow and air exchange, especially around doors, windows, chimneys
Check for hidden major air leaks through fabric

SPACE FEELS TOO COLD

Radiant heat loss to thermal bridges or materials that readily absorb heat from the body, such as:

- large areas of glass
- thick masonry walls
- cold floors

Inadequate heating, or heating/cooling system that is badly controlled

Is it a problem at most times, or only in certain conditions or times of the year?
What activities are happening in the room? How are occupants dressed?
What is the heating system? How is it controlled?

SPACE FEELS TOO HOT

Solar gain, especially through large areas of glazing
Inadequate ventilation
Extensive heating system and insulation
Inadequate cooling, or heating or cooling that is badly controlled

Is it a problem at most times, or only in certain conditions or times of the year?
What activities are happening in the room? How are occupants dressed?
Check air temperature, ventilation and air exchange
What is the heating/cooling system? How is it controlled?
How is the building insulated?

SPACE FEELS HUMID

Condensation problems
Insufficient air exchange and/or air movement
Incorrect heating system, or control of heating system
Building use involves a great deal of moisture
Moisture-resistant materials have been used, such as AVCLs, water-resistant insulation, or impermeable wallpapers or paints

Are there any building flaws letting in liquid moisture?
Is it a problem at most times, or only in certain conditions or times of the year?
Is it a problem in all rooms, or only in some parts of the building?
Check airflow and air exchange, especially around doors, windows, chimneys
Monitor to determine vapour content of air, and identify sources of vapour

Dealing with Moisture from the Ground

In masonry walls that have not been rendered with cement or given some other waterproof finish, groundwater is unlikely to affect more than the first course or two of masonry, but cellars, underfloor voids, and the walls of buildings where the earth has been allowed to build up against the exterior, may be very wet on the interior.


Preventing Lateral Penetration

If there is a problem that cannot be managed by maintenance or repair of the existing drains, or by installing land drains uphill from the building, there are two principal approaches: to add a waterproofing layer on the buried section of the wall, or take back the earth to create a ventilated trench. Both require excavation near the footings, and so will probably need advice from a structural engineer as well as a drainage expert. If the building is listed or the surroundings of historic importance, digging may require statutory consent, and possibly archaeological supervision.

Excavation

Historically, the ground outside basements or cellars in use was sometimes dug away to match the interior ground level, forming well areas or perimeter passageways. This approach allows the walls to dry out and stay dry, but excavation around an existing building is a costly and invasive exercise that may have both structural and archaeological implications, and could change the character of the building. It is only possible where excavation would not endanger the structure, and where it does not impinge on building or landscape significance. Excavations should generally incorporate a land drain as a fail-safe.

To separate an exterior wall from the ground abutting it, and thereby prevent lateral penetration of water, one approach is to use a geodrain. This must be capped at the top to ensure that water flowing down the walls travels over the geodrain, rather than behind it.

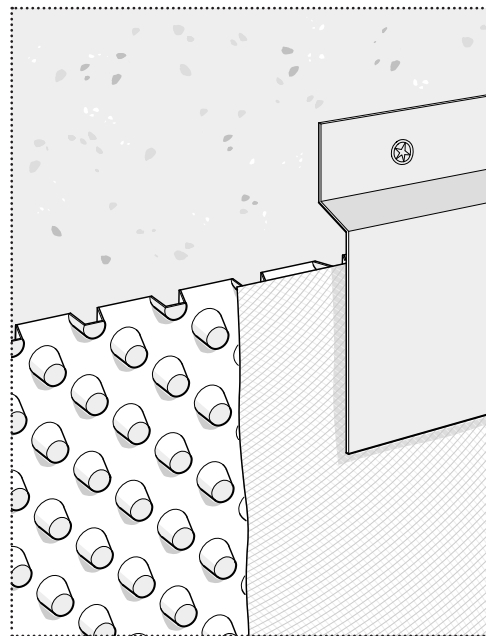

Waterproofing

Waterproofing coatings and metal flashings are not likely to have long lifespans when buried and exposed to quantities of water and salts from the ground, and so a modern geodrain (a plastic barrier with integral drainage channels) may be a better choice. This will need to connect at the bottom to the drain, and be flashed at the top to prevent water washing down the walls from entering. It will need to be replaced when it begins to fail.

Barriers such as geodrains do entail some risk. There is likely to be some leaking through and especially under the barrier, and if water does get in to the wall, it will be able to dry only towards the interior.

Damp Proofing

Damp proofing, which was first introduced in the second half of the 19th century to prevent damage from faulty sewers, is now an automatic inclusion in new construction. A damp-proof course [DPC] is a layer of some waterproof material such as sheet lead, slate, bituminous felt or plastic carried through the entire thickness of the wall just above the ground, to cut off water rising from the footings. This may be bedded into the joint between two courses of masonry, or set on the top of the plinth supporting a timber frame or an earthen wall, or some other moisture-sensitive form of construction. A damp-proof membrane [DPM] is usually a thick sheet of polythene, which may be used in various ways: for example, to protect church monuments positioned against exterior walls, or to isolate a concrete floor slab.

Injected 'damp-proofing' systems are not recommended for building conservation: not only is there no evidence that they work, but the risk from the associated cement renders and the damage from drilling multiple holes into the wall through which large quantities of liquid are introduced make them unacceptable (see **Deterioration & Damage: Problems Due to Alterations & Interventions**).

Drying Wet Fabric

It is rarely necessary to install any special systems to dry walls recovering from moisture problems, except perhaps where the source of the water was widespread and prolonged: a flood or fire, for example (see the **Special Topic: Dealing with Disasters**).

Drying proceeds in two stages, and it is only the first – Stage I, where there are liquid flow paths from the centre of the material to the surface – that is able to remove substantial quantities of moisture from bulk material (see **Building Science**). Where possible, it is desirable to prolong Stage I drying so that more moisture is removed from the walls, so it is usually best not to accelerate the process to any great degree: slight airflow and good air exchange can often be helpful, but strong heating and too-powerful fans can easily dry the surface pores, moving the process into Stage II drying (which is very slow). Rapid drying also increases the risk of material damage.

Certainly drying should not be accelerated until all leaks have been dealt with: if the moisture sources have not been removed, drying will never be effective, whatever the mechanism. Trying to dry fabric wetted continually by a high water table, for example, would simply pull more water through the wall, exacerbating deterioration and raising the humidity within the room.

Proprietary treatments for drying 'damp walls', such as electro-osmosis, are generally unnecessary, and may prove counter-productive.

It is very rare that a DPC or DPM will be found to be a desirable option for controlling water: it risks moving the moisture problem elsewhere. To protect a building with its footing immersed in water, the damp proofing would need to form an unbroken barrier across the floor and through the walls, and an internal perimeter drain would need to be installed together with a pump to take the water it collects back to the exterior. Retrofitting damp-proof coursing into a building which was never designed to incorporate one is extremely invasive: to protect timber cill beams resting on damp masonry plinths from decay the frame would have to be jacked up section by section to insert the DPC; masonry walls would need to be cut through section-by-section using special saws, or long drills and chisels. It is difficult to imagine any situations where such invasive works would be justifiable.

Managing Birds

Whether birds cause serious problems depends both on the habits of the species, and on where the perches, nests or roosts are located on the building. Since many different birds depend on buildings for nest sites, it may be necessary to balance nature conservation and building conservation. Information about the conservation status and the control of different bird species can be obtained from the Royal Society for the Protection of Birds.

Many different approaches to bird deterrence have been tried, including flying hawks, scarers and audible repellents, but these do have certain drawbacks, not least that their action is not species-specific. Culling is often proposed for controlling pigeon populations, but it is never effective unless the population is very small and isolated; otherwise, birds in neighbouring areas will simply move in.

Laws Protecting Birds

All wild birds, together with their nests and eggs, are protected by the Wildlife & Countryside Act 1981. It is an offence to damage or destroy an active nest, or to prevent the parent birds having access to it. In the case of birds that are listed on Schedule 1 of the Act, such as the barn owl, it is an offence even to disturb the birds when they are near or at the nest.

In England, General Licences are issued by the Government to allow 'authorised persons' (the owner or tenant of the land or property, or someone acting with the owner's permission) to kill or capture certain species of birds, including feral pigeons. General Licences allow people to carry out activities that affect protected species without the need to apply for a personal licence. They are only used for activities that carry a low risk for the conservation or welfare of the protected species, and where a personal licence would be routinely issued. If a building manager plans to act under the authority of a General Licence, they must be satisfied that they are eligible to do so and must act within the provisions of the relevant General Licence: the conditions of the licence must be checked carefully to ensure that the situation is covered, and to comply with these conditions. If the planned work cannot be carried out under the provisions of a General Licence, a specific or individual licence must be sought from Defra. Details of general licences can be found at www.naturalengland.org.uk/ourwork/regulation/wildlife/licences/generallicences.aspx#a

Legislation can change rapidly according to the conservation status of the bird, so it is important that the latest advice is sought from the relevant government department before any action is taken. The website of the Royal Society for the Protection of Birds [RSPB] also has excellent and detailed advice (www.rspb.org.uk).

All bird nests are protected by law: it is illegal to intentionally disturb or destroy the active nest of any wild bird. Nestlings must be allowed to fledge before any action is taken to block access or remove nests. If nests are found during roofing works, eggs and nestlings should not be disturbed, and Natural England should be consulted.

Endangered species should be allowed to nest wherever there is no direct conflict. If the roof must be sealed off to prevent damage, nest boxes can be positioned under the eaves for threatened birds such as starlings, sparrows and swifts; these can be cleaned after the breeding season to limit the number of parasites. Shelves can also be fitted below the nests to catch droppings.

If nests must be removed, it will be necessary to ensure that they are no longer in use (for larger buildings and commercial properties, it is wise to seek advice from an independent specialist organisation such as the Pigeon Control Advisory Service).

Preventing Perching

Feral pigeons and other troublesome birds will perch on buildings to overlook regular food sources. If perching is a problem, the most important step is to try to remove the source of food (for example, preventing people feeding pigeons in the area).

Preventing Roosting & Nesting

Birds such as pigeons need to be prevented from entering areas where they may roost or nest in numbers, such as courtyards, balconies and windows, or around statuary or pipe work. Roosting sites may also be popular with other more desirable birds; but fortunately pigeons are large, so it is often possible to exclude them and not the smaller songbirds.

The problem will have to be dealt with in the winter, ideally between October and February when birds should have finished nesting. Any holes or gaps giving access to the roof or some other sensitive area of the building will need to be cleaned out and sealed, which should be done mid-morning to minimise the risk of trapping any roosting birds. If there is any doubt as to whether all birds have left, a fine wire mesh can be fixed over the entrance, and checked at intervals to ensure that no birds are trapped; permanent repairs can be made when it is certain that no birds remain.

The access to the site will then need to be repaired, or blocked off with netting or the correct wire or nylon mesh. Monofilament mesh, for example, comes in a range of sizes: 19 mm for birds as small as sparrows, 28 mm for starlings and larger birds, 50 mm for pigeons, and 75 mm for gulls. If well installed, netting can be relatively inconspicuous, and does not noticeably reduce light levels in the building. However, it does tend to trap windblown leaves and rubbish, so maintenance is an important issue.



Netting and mesh

Netting can provide some protection from birds for elaborate features on the building façade, but it is not necessarily unobtrusive.

COMMON INDOOR AIR CONTAMINANTS		
PRINCIPAL SOURCE		CONTAMINANTS
BUILDING & FURNISHING MATERIALS	Fabric Underlying ground	Dust, glass fibres, asbestos fibres, radon
	Paints and glues, including those in laminated wood Cleansers, disinfectants and solvents	Volatile organic compounds (VOCs) such as formaldehyde Heavy metals such as lead
	Off-gassing (such as the softeners and solvents released by many industrial plastics)	Toxins of various types and degrees of seriousness (such as cyanide from some types of rubber-based sealants)
	Treatments such as biocides	Biotoxins
MICRO-ORGANISMS	Furniture	Dust mites
	Damp materials Stagnant water	Fungi spores, mould spores, bacteria
BUILDING USE	Heaters burning carbon-based fuels Diesel-powered generators Combustion engines (for example, cars)	Carbon monoxide; particulates
	Furniture Occupants	Carbon dioxide; dust
	Photocopiers Electric motors Electrostatic air cleaners	Ozone



The storage tanks of air-conditioning systems, which are often found on the rooftops of commercial buildings, can support the growth of microorganisms such as *Legionella* bacteria.

HEALTH HAZARDS IN BUILDINGS

An assessment of health hazards in a building may be desired for one of two basic reasons:

- works are being proposed that could expose the workers or other building users to hazardous materials (such as asbestos, lead or bird droppings)
- building users are reporting health problems that could be associated with the building or its contents (such as respiratory problems).

Although health problems reported by occupants can arise from any combination of contaminants, the underlying causes are often linked to environmental issues such as inappropriate temperatures and humidities, or insufficient intake of outdoor air.

In cities particularly, commercial buildings are often airtight and use central air plants deliberately designed to limit air exchange with the exterior. This makes it easier and cheaper to condition the building air, and reduces the need to precondition incoming air to bring it to the right temperature or to filter it to remove pollutants, but its unfortunate side-effects cannot be denied. In poor air-conditioning systems, the building air is run through the ceiling and underfloor spaces, which are usually very dirty; even ducts and filters may only rarely be cleaned.

ASSESSING HEALTH HAZARDS

Assessments of hazards during building works in the UK are covered by the Health and Safety Executive. The latest regulations and practice recommendations should always be consulted and followed (www.hse.gov.uk).

It is harder to assess health problems associated with use of the building, because potential causes are many, and active factors are challenging to isolate. Not only all information about symptoms, but the nature of the building itself, will need to be taken into account. For example, if the building was constructed in the 20th century, or has major 20th-century renovations, asbestos may be a risk.

An assessment survey should be made to investigate all possible causes of discomfort, including the lighting and heating, the fabric and furnishings, and the air plant. Forced ventilation should be checked to determine the mix of outdoor and indoor air, the air distribution, and the nature and state of the ducting and the filtration systems. All possible issues, from mould growth to ozone-generating equipment or sources of standing water, will need to be mapped and compared to patterns of occupancy and illness.

In some cases it will prove necessary to call in experts to analyse samples of the air and from building surfaces, or to monitor pollutants, or to study airflow. Further information about general environmental monitoring can be found in **Assessing the Environment: Specialist Investigations**.

ALTERATIONS TO THE BUILDING ENVELOPE

Aside from the many passive and managerial actions that can be taken to reduce the risk of disaster, there are a number of interventions on the building envelope that prevent or reduce damage from flood and fire, and less common disasters such as lightning strikes and earthquakes.

FLOOD-PROTECTION ALTERATIONS

Floodproofing can take many forms, including meticulous maintenance of plumbing and other internal sources of water. For ground floods, where the sources are coastal flooding, riverine flooding or flash flooding, the options are trying to divert the water away from the building, or to stop it at or preferably before it reached the envelope. For buildings prone to repeated ground flooding, it may also be wise to limit damage by internal rearrangements.

IMPROVING RESISTANCE TO GROUND FLOODS

Measures to prevent or limit the damage from ground floods vary widely in cost, effectiveness and invasiveness; no single solution is right for every building, and indeed most would only be considered for buildings at significant risk. Modifications fall into three groups:

- works to the surroundings to make flooding less likely
- works to the building to stop floodwaters entering
- works to the building to restrict the amount of damage if floodwaters do enter.

Factors to be considered when weighing up the cost of intervention against the likely benefit include the types of flooding that are likely to be encountered (both sources and duration), how often such floods may occur, how much warning is likely to be received, and of course the exposure of the building. For example, a basement flat in a city may be at sufficient risk from flash runoff floods, water-main bursts or blocked sewers to make it worthwhile to install some form of permanent low barrier at the base of the door.

Making Flooding Less Likely

Most district flood prevention work is the province of the Environment Agency and associated government organisations, but there are a number of actions that can be taken if the building owners have access to the surrounding ground, and there are no insurmountable issues related to historic landscapes or gardens, or buried archaeology. The most important are:

- to ensure that any existing land and building drainage is in good condition, or install improved drainage systems
- to re-landscape to redirect surface water away from the building, and to replace impermeable surfaces with materials that allow the water to soak into the ground.

Preventing Water Entering the Building

Floodwater can enter the building through:

- floors and exterior walls (especially through cracks and joints)
- windows and doors
- other apertures in the envelope, such as vents, air bricks, pipe ducts, and gaps around piping and cabling
- partition walls from neighbouring properties
- back-flowing plumbing systems and sewers.

The first step is therefore to find some way of permanently or temporarily sealing any flaws or apertures. Permanent actions include repairing faulty pointing, replacing cracked cement renders, and sealing gaps around piping and cabling that passes through the exterior walls. For apertures that have important uses, such as doors and drainage holes, sealing methods will need to be demountable. This stops them acting if the flood arrives without warning, so it may be necessary to consider hybrid systems if the risk of flash flooding is very high.



There are a number of systems designed to be applied to the building perimeter to stop floodwaters entering. Most will only hold the water back for a short time, but this may be long enough to prevent damage from flash floods, or (for floods of longer duration) to allow the building contents to be moved or otherwise made safe. Structural engineers do generally advise, however, that no more than one metre or so of floodwater should be held back at the building envelope, since the pressure exerted on the exterior walls by more water than this could cause structural damage.

Buildings may have little protection against runoff floods, which can result from burst water mains and sewers, as well as from heavy rainfall.

Over the past two centuries, the amount of energy consumed to make and operate buildings has increased tremendously. The Industrial Revolution relied upon the exploitation of fossil fuels, starting with coal. Lower energy costs made energy-intensive materials like glass and steel easier and cheaper to make, and as a result new architectural systems began to replace traditional forms of construction. At the same time, developments in mechanised transport made centralised processing and production feasible, and soon led to larger and more sprawling cities. Habits and expectations of individuals and organisations also changed, while building operation became more energy-dependent (see **Controlling the Interior Environment**, in the main text of this volume).

Energy Use & Carbon Emissions

To reduce emissions, the options are to save energy, reduce electricity use and switch to low-carbon energy supplies.

When burnt, the carbon and hydrogen in fossil fuels combine with oxygen to produce heat, carbon dioxide and water. The quantity of carbon dioxide released in relation to the amount of energy produced (expressed as kilograms of CO₂ per kilowatt-hour [kgCO₂/kWh]) depends on the fuel source, and the efficiency of the system used to convert it to heat or electricity. The percentage of emissions attributable to using electricity is very high, because on average UK thermal power stations deliver roughly a third of the energy contained in the fuel as electricity at the point of use. In the UK between 2005 and 2010, a typical carbon factor (the emission rate per unit of energy at the point of use) for electricity was 0.53 kgCO₂/kWh, while that for gas was 0.185 kgCO₂/kWh. UK government policy is to reduce the carbon content of national electricity generation, but this will take time to happen.

Regardless of its carbon content, saving electricity is important because of its relatively high energy cost. After accounting for generation and distribution losses, thermal power stations in the UK deliver only about a third of the energy contained in the fuel as electricity at the point of use (as a comparison, the efficiency of an 'A-rated' gas, LPG or oil-fired boiler is around 90 %).

THE IMPACT OF THE ENERGY SUPPLY

The choice of energy supply for a building will have many effects at the national level:

- *Avoided requirements*
Power from local renewable generation (solar, wind or water power) may be intermittent, which means that central supplies may be called upon from time to time. This has implications for the national supply in terms of capacity, management and efficiency, as well as on carbon factors.
- *Reduced requirements*
The benefits of improved efficiency at the local or community level (for example, using electricity in heat pumps, or fossil fuels in Combined Heat and Power [CHP] systems) may not be entirely straightforward. Energy use can increase if a CHP is not available, or a heat pump is inefficient at the time the electricity grid is under stress because of a cold winter spell.
- *Lower-carbon fuels*
Burning gas produces less carbon per kWh than burning either oil or coal, but the associated methane leaks from production and distribution need to be properly taken into account.
- *Biofuels*
Biofuels must be sustainably produced, so a high proportion of the carbon released when they are burnt can be sequestered by the growth of new crops. Unfortunately, some biofuels require high inputs of fossil fuels to produce, and others may be provided unsustainably.

ENERGY & CARBON IN THE BUILT ENVIRONMENT

509

Given a particular site and context, the three most important influences on a building's energy use in operation are:

Fabric

The principal factor to be considered is how effective the building envelope is in providing a suitable indoor environment passively (including buffering of heat, humidity, and solar gain; providing natural ventilation and lighting via daylight).

Equipment

The equipment is the actual user of energy. This includes both the fixed building services (principally heating, cooling, ventilation, hot water, and lighting), and the other energy-consuming equipment (for example, the computers and appliances used for business, cooking, or entertainment).

People

Factors to consider include how the occupants maintain their buildings; the standards they consider appropriate for the internal environment; the technical services and equipment they bring in; and how they occupy the spaces.



These factors are highly interdependent: for example, the effectiveness of a building envelope will critically depend on how well it is maintained, and the control, maintenance and operation of the technical systems will affect fabric, people and the amount of energy used. The complex system of fabric, equipment and people must be looked at holistically if the use of energy in the building is to be understood and reduced.

BUILDING ENVIRONMENT

SPECIAL TOPIC: Improving Energy & Carbon Performance

Measuring Thermal Performance

To fully understand how the building envelope is performing, measurement will sometimes be needed. A variety of techniques and equipment can be used; few are technically challenging, though all demand some expert interpretation. Expertise may also be needed to judge which factors are critical: for example, draughts can be a major source of discomfort, and therefore put greater occupant demands on the conditioning systems, but they do not necessarily originate from air leaks; many are triggered or exacerbated by local heating or cooling (cold air returning over the floor to replenish the hot air rising from a radiator or convector, or draughts from tall, cold window surfaces).

Measurements can be made at three levels: basic (typically spot checks made with relatively easy-to-use equipment); intermediate (requiring more time or preparation, or more elaborate equipment); or advanced (often needing specialist equipment and expertise, and possibly disruptive and time-consuming). Only rarely will the answer to the questions being asked be so critical as to require advanced assessment.

The table below summarises some of the main methods used to measure air infiltration, heat transfer and radiant heat exchange when assessing the thermal performance of the envelope for an energy assessment; more details of measurement and monitoring can be found in the main text ([Assessing the Building Environment](#)).

MEASUREMENT TECHNIQUES			
GENERAL COMMENTS	BASIC	INTERMEDIATE	ADVANCED
AIR INFILTRATION			
Occurs not just through doors and windows, but via holes and cracks, where window and door frames meet the walls, between floorboards and often behind skirtings	Hand-held smoke sticks or chemical smoke puffers; note that there may be constraints on using these in some historic interiors Dry ice	Fan pressure testing can quantify the infiltration rate and allow targets for improvement to be set; specialists can usually make tests within a few hours, even on large buildings Pressure testing is also valuable in the course of alteration work, to establish quality standards and to identify any remaining sources of leakage	Tracer gases or smoke tests to find rates and routes of air circulation (latter will require smoke detectors to be switched off, and neighbours and fire authorities to be alerted) All smoke generators leave deposits on surfaces, and so smoke tests may not be possible in sensitive historic interiors
HEAT TRANSFER THROUGH THE FABRIC			
Tests here can be useful, but are only practicable in cold weather, typically November to February U-values are not constant, but will vary with moisture, wind and solar radiation	Checks of the thermal envelope can be made with an infrared camera, which can draw attention to areas of excessive heat loss Interpretation is challenging and needs care, especially when looking at glass and metal	Heat-flux sensors attached to the surface of the fabric at typical points, to monitor heat movement; to calculate U-values, exterior and interior temperatures must also be measured Will usually take several weeks for readings to become steady enough for an assessment of thermal transfer	Co-heating tests, which measure the energy used to keep a building at typically 25°C, are best suited for research, as the process takes several weeks (during which the building cannot be occupied) Cannot be used if the building fabric or contents are sensitive
RADIANT HEAT EXCHANGE			
The loss or gain of radiant energy from occupants can be difficult to measure accurately, because not all the surfaces in a room will be at the same temperature	Empirical (sensation of heat loss)	Infrared cameras	Black-globe thermometer to measure the 'mean radiant temperature' at a particular point, and readings used to determine the 'operative temperature' (weighted average of air temperature and mean radiant temperature, with allowance for air movement)

The review of the energy use and equipment should include:



- annual energy consumption, by fuel and preferably by end-use
- a summary of how the building is managed and maintained, and of how the services and equipment are operated and controlled (both centrally and locally)
- an assessment of each item of energy-consuming equipment: what is there, its size and condition, its appropriateness to the building and the building's uses, and how it is being operated
- a summary of how committed the building occupants and managers are to reducing energy use
- a summary of any opportunities for making improvements, and of possible risks and constraints.

Determining how and where energy is being used will not only make it clear what actions would be likely to reduce consumption most effectively, but could also draw the attention of occupants to wasteful practices and habits, obtain their detailed feedback, and trigger simple and effective behavioural improvements.

Limitations on thermal imaging

Imaging glass is particularly difficult: glass is opaque to infrared, and it is also highly reflective. It is perilously easy to over-interpret thermal images of façades: here, the same windows imaged twice in quick succession on the same camera show a wide variation in 'surface temperature' readings, due almost entirely to reflectivity.

Inaccuracies must be minimised as far as possible by controlling how and when the image is taken, by processing the images with care, and finally by interpreting the results in the light of a good understanding of how building systems behave.

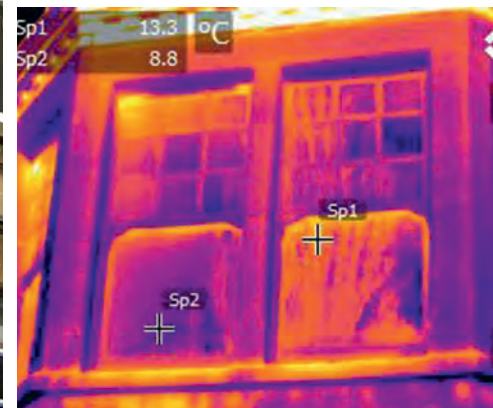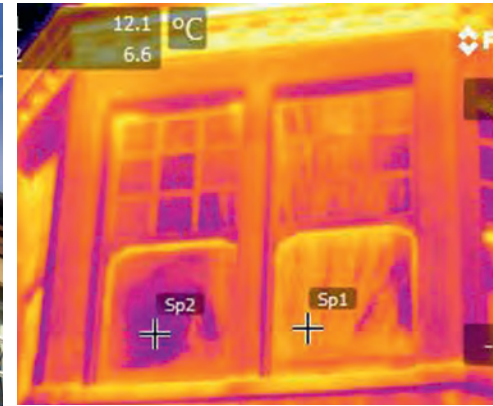

BUILDING ENVIRONMENT

SPECIAL TOPIC: Improving Energy & Carbon Performance

CHECKLIST: INCREASING THE THERMAL RESISTANCE OF WALLS

ACTION	GENERAL COMMENTS	OTHER CONSIDERATIONS
SIMPLE ACTIONS		
REPAIR (INCLUDING REPOINTING & REPAIRS TO PERMEABLE RENDERS)	Appropriate repairs will improve airtightness and water penetration (a dry wall will transfer much less heat); the materials volumes in this series give information about the repair of walls of various types	The correct intervention depends on the materials and construction of the wall; but permeable materials such as lime mortars and renders should always be used Consider replacement of impermeable renders and mortars where practicable
INTERMEDIATE ACTIONS		
RENDERING	Applying a permeable render can benefit both solid and cavity walls Renders will cut air infiltration and water penetration Dry walls have much more thermal resistance	Use only permeable materials such as lime-based mortars; additives such as hemp can increase insulating capacity Rendering will alter the appearance of the building Many older buildings were rendered in the past, so there may be a precedent in historic records
PLASTERING	Applying a permeable plaster can benefit both solid and cavity walls	Use only permeable materials such as lime-based mortars Additives such as hemp can increase insulating capacity
INTERIOR HANGINGS OR PANELLING	Lining the interior with thinnish sheets of permeable material, battened off the wall, will improve thermal response and reduce radiant heat loss	There will be an impact on appearance, and some reduction in the usable area of the room; panelling may be difficult to detail around original features such as decorative cornices It is wise to design panelling to be easily openable to check the condition of the wall behind

External wall insulation will have a serious impact on a building's appearance, though if a façade is in poor condition it may sometimes be possible to incorporate the measure into a sensitive programme of improvement or restoration.

External insulation carries a high technical risk, and so must be meticulously well designed and installed. The loss of water-shedding details such as drip mouldings can lead to water ingress, and leaks may occur at eaves and cills, and around pipework (note the water stain at the corner of the window here). This is of great concern since the insulation will also reduce evaporation from the wall, and may hide signs of water problems until they are very well established.



CHECKLIST: INCREASING THE THERMAL RESISTANCE OF WALLS

ACTION	GENERAL COMMENTS	OTHER CONSIDERATIONS
CHALLENGING ACTIONS		
INSULATION	<p>Demands careful design, correct choice of materials, good detailing and extremely high standards of workmanship</p> <p>Methods and materials will vary according to type of wall, and whether it is being insulated externally, internally or by filling a cavity</p> <p>Great care must be taken to eliminate all possible moisture sources from the wall before works begin</p> <p>Internal and external wall insulation will hide the condition of the wall beneath, so it is wise to consider installing time-of-wetness sensors or other moisture monitoring to reveal problems should they occur</p>	
INTERNAL WALL INSULATION		
	<p>Permeable, hygroscopic insulation would normally be preferable</p> <p>Thickness may need to be limited to reduce condensation risk</p> <p>Significantly reduces interior floor space, which can be problematic in small rooms</p> <p>Installation requires the occupants to vacate the building</p> <p>Tends to cause problems of thermal bridging</p>	<p>To limit thermal bridging, partial insulation may be necessary to upper floors, partitions and party walls where these meet the insulated wall</p> <p>Internal services, including electrical wiring and heating pipework, may need to be rerouted</p>
EXTERNAL WALL INSULATION		
	<p>Where space is available, exterior wall insulation can safely be made much thicker than interior wall insulation</p> <p>Advantage can be taken of the thermal mass of the wall to help buffer temperature fluctuations and reduce risks of summer overheating if night ventilation is adequate</p> <p>Can be installed while the building remains in occupation</p> <p>Presents fewer problems with thermal bridges than internal wall insulation</p> <p>Insulation must be protected from the weather by a render, or some other protection such as cladding, or hanging tiles or slates</p>	<p>Carries a significant risk of inducing or exacerbating liquid-moisture problems</p> <p>External pipes, gutters and other services will usually need to be removed and altered before replacement</p> <p>Detailing (especially around openings, and at cornices and eaves) must be meticulous, since any water entering from leaks or condensation will be trapped behind the insulation; problems may go unnoticed until they become very serious</p>
CAVITY WALL INSULATION		
	<p>Increases the thermal resistance of the wall, but does not affect its appearance</p> <p>Least risky in dry, sheltered areas; caution is needed in sites prone to driving rain</p> <p>Loose fill materials should be used rather than foam to give some potential for extraction (which is still extremely difficult)</p> <p>Cavity walls can also be insulated internally or externally</p>	<p>Carries a significant risk of inducing liquid-moisture problems</p> <p>If the cavities open into the roof space, they must be closed</p> <p>Borescope investigations should be made to locate moisture sources, and thermal and moisture bridges; these must be dealt with before insulation</p> <p>Not suitable for cavity walls bonded with bricks</p> <p>Always use reputable contractors, and obtain appropriate insurance-backed warranties</p>
INSULATION OF FRAMED CONSTRUCTION		
	<p>Sometimes possible when cladding or interior finishes are removed for maintenance</p> <p>Options are similar to those for insulating roofs at rafter level</p>	<p>If insulation is entirely within the framing, the frames will act as thermal bridges; it is therefore best to combine insulation between the framing with a complete skin of render or insulation (preferably on the exterior)</p>

BUILDING ENVIRONMENT

SPECIAL TOPIC: Improving Energy & Carbon Performance

If you require an alternative accessible version of this document (for instance in audio, Braille or large print) please contact our Customer

Services Department:

Telephone: 0870 333 1181

Fax: 01793 414926

Textphone: 0800 015 0516

E-mail: customers@english-heritage.org.uk







Historic England

Energy Efficiency and Historic Buildings

Insulating Solid Walls



This guidance note has been prepared and edited by David Pickles. It forms one of a series of thirteen guidance notes covering the thermal upgrading of building elements such as roofs, walls and floors.

First published by English Heritage March 2012.

This edition (v1.1) published by Historic England April 2016.

All images © Historic England unless otherwise stated.

Illustrations drawn by Simon Revill.

Our full range of guidance on energy efficiency can be found at:

[HistoricEngland.org.uk/energyefficiency](https://www.historicengland.org.uk/energyefficiency)

Front cover:

It is worth trying to establish the form of construction for the external wall.

Summary

This guidance note provides advice on the principles, risks, materials and methods for insulating solid masonry walls. Traditional solid wall construction is often the most difficult and in many cases the least cost effective part of a building to insulate. However, adding insulation to solid walls can lead to a significant reduction in heat loss but thought and care is needed to make sure the works are appropriate, effective and do not cause long-term problems.

Whether applied externally or internally, this type of work can have a significant impact on the appearance of the building. Wall insulation will also alter the technical performance of the solid wall and can either exacerbate existing moisture-related problems or create new ones. In some cases the technical risks of adding insulation to solid walls will be too great and alternative ways of providing a more cost effective long-term solution to improving energy efficiency may be more appropriate.

External insulation can be particularly difficult to incorporate into some older buildings as costly ancillary adaptations such as changes to the eaves and verges of roofs, drainage pipework, and window and door reveals are often required. As a consequence such works needs a high degree of quality control.

For listed buildings any form of wall insulation is likely to require consent. For many buildings, including those in conservation areas and national parks, external wall insulation will usually require planning permission.

Contents

Introduction.....1	3	External Wall Insulation.....11
Energy Planning.....1	3.1	Physical adaptation of the building.....11
Technical Risks.....1	3.2	Changes in the appearance and character of a building.....11
Technical Details.....2	3.3	Changes in moisture movement within the wall.....12
1 Issues to Consider Before Adding Wall Insulation3	3.4	Materials.....12
1.1 Construction3	4	Internal Wall Insulation13
1.2 Breathing performance5	4.1	Physical adaptation of the building.....14
1.3 Thermal mass.....6	4.2	Changes in the appearance and character of a building.....14
1.4 Building context.....6	4.3	Changes in moisture movement within the wall.....16
1.5 Wall condition.....7	4.4	Materials.....18
1.6 Salts8	5	Where to Get Advice.....19
2 Solid Wall Insulation.....9	5.1	Contact Historic England20
2.1 Cost-effectiveness.....9		
2.2 Impermeable materials.....9		
2.3 Thermal bridges.....10		

Introduction

Energy Planning

Before contemplating measures to enhance the thermal performance of a historic building it is important to assess the building and the way it is used in order to understand:

- the heritage values (significance) of the building
- the construction and condition of the building fabric and building services
- the existing hygrothermal behaviour of the building
- the likely effectiveness and value for money of measures to improve energy performance
- the impact of the measures on significance
- the technical risks associated with the measures

This will help to identify the measures best suited to an individual building or household, taking behaviour into consideration as well as the building envelope and services.

Technical Risks

Altering the thermal performance of older buildings is not without risks. The most significant risk is that of creating condensation which can be on the surface of a building component or between layers of the building fabric, which is referred to as 'interstitial condensation'. Condensation can give rise to mould forming and potential health problems for occupants. It can also damage the building fabric through decay. Avoiding the risk of condensation can be complex as a wide range of variables come into play.

Where advice is given in this series of guidance notes on adding insulation into existing permeable construction, we generally consider that insulation which has hygroscopic properties is used as this offers a beneficial 'buffering' effect during fluctuations in temperature and vapour pressure, thus reducing the risk of surface and interstitial condensation occurring. However, high levels of humidity can still pose problems even when the insulation is hygroscopic. Insulation materials with low permeability are not entirely incompatible with older construction but careful thought needs to be given to reducing levels of water vapour moving through such construction either by means of effectively ventilated cavities or through vapour control layers.

The movement of water vapour through parts of the construction is a key issue when considering thermal upgrading, but many other factors need to be considered to arrive at an optimum solution such as heating regimes and the orientation and exposure of the particular building.

More research is needed to help us fully understand the passage of moisture through buildings and how certain forms of construction and materials can mitigate these risks. For older buildings there is no 'one size fits all' solution, each building needs to be considered and an optimum solution devised.

Technical Details

The technical drawings included in this guidance document are diagrammatic only and are used to illustrate general principles. They are not intended to be used as drawings for purposes of construction.

Older buildings need to be evaluated individually to assess the most suitable form of construction based on a wide variety of possible variables.

Historic England does not accept liability for loss or damage arising from the use of this information.

1 Issues to Consider Before Adding Wall Insulation

The construction, condition and thermal performance of solid walls needs to be fully understood before adding any insulation or there could be a risk of creating long-term problems. Solid masonry walls have very different physical and performance characteristics to modern cavity walls. A separate guidance note is provided in this series for older buildings with early forms of cavity wall, [Insulating Early Cavity Walls](#).

1.1 Construction

The first step should be to identify the materials used for external wall materials and how they have been constructed. Many older buildings may have three or four different types of wall construction, reflecting different stages of development. Construction can vary from single-skin brickwork to stone walls as narrow as 100 mm thick up to rubble-filled walls of a metre or more thickness. Wall materials can include bricks of varying hardness and permeability, dressed stone blocks of varying types, rubble stone, flint and rammed earth. Mortars can also be earth and/or lime based, also with wide variations in permeability and durability.

A single wall will often contain more than one material with quite different performance characteristics. For example, soft porous chalk and hard impervious flint have very different properties but are commonly found in the same wall. The presence of voids, irregular bonding

patterns and concealed timbers also add to the complexity of solid wall construction and performance.

Theoretical models and calculations are frequently used to understand and assess the movement of energy and moisture through solid walls, often using quite sophisticated computer programmes. However, the data giving the thermal transmittance and moisture permeability of many traditional materials is simply not available and calculations at present are based upon idealised, homogenous walls. The actual variations within the wall and the influence of other variables, such as the presence of salts, can make such calculations very misleading when applied to many solid walled buildings. If theoretical modelling is used as a basis for the design of thermal upgrading, then accurate data should be used and the performance should be closely monitored after installation for any problems.



Figure 1

The first step should be to identify the external wall materials and their form of construction. Construction can vary from single skin brickwork to rubble filled stone walls of a metre thickness or more. A single wall will often also contain more than one material with quite different performance characteristics.

Traditional breathing performance

Most traditional buildings are made of permeable materials and do not incorporate the barriers to external moisture such as cavities, rain-screens, damp-proof courses, vapour barriers and membranes which are standard in modern construction.

As a result, the permeable fabric in historic structures tends to absorb more moisture, which is then released by internal and external evaporation. When traditional buildings are working as they were designed to, the evaporation will keep dampness levels in the building fabric below the levels at which decay can start to develop. This is often referred to as a 'breathing' building.

If properly maintained a 'breathing' building has definite advantages over a modern impermeable building. Permeable materials such as lime and/or earth based mortars, renders, plasters and limewash act as a buffer for environmental moisture, absorbing it from the air when humidity is high, and releasing it when the air is dry. Modern construction relies on mechanical extraction to remove water vapour formed by the activities of occupants.

As traditional buildings need to 'breathe' the use of vapour barriers and other impermeable materials commonly found in modern buildings must be avoided when making improvements to energy efficiency, as these materials can trap and hold moisture and create problems for the building. The use of modern materials, if essential, needs to be based upon an informed analysis of the full implications of their inclusion in order to minimise the risk of problems arising.

It is also important that buildings are well maintained, otherwise improvements made in energy efficiency will be cancelled out by the problems associated with water ingress and/or excessive draughts.

1.2 Breathing performance

Traditional solid walled buildings are often referred to as 'breathing' structures, meaning that they exchange moisture readily with the indoor and outdoor environment. Where insulation is introduced it is important that this characteristic is taken fully into consideration.

It is important to understand that moisture in solid walls comes from several possible sources:

- **Water from rainfall:** This obviously affects solid walls but not all internal damp is a result of penetrating rain. With the exception of extremely exposed locations such as on the coast or high ground, it is unusual for driving rain to pass through most solid walls in good condition. Normally it will only saturate the outer part of the wall, which will then dry out when the rain stops
- **Rising ground moisture:** This can be present in any solid wall which does not have a physical damp proof course. In such situations the moisture level is generally controlled by the 'breathability' of the material, which limits total moisture by allowing the excess to evaporate harmlessly away
- **Moisture generated in the building:** It is often underestimated how much moisture can be generated by people using a building, simply through breathing but also from cooking and washing. The permeability of external solid walls also significantly helps to buffer and control excess moisture and condensation from these sources

Materials used in repair and maintenance must be selected with care to preserve this permeability. Impermeable materials – such as vapour control layers, cement based renders and pointing and many modern 'plastic' paints and coatings can significantly impair the performance and trap moisture. Often this will also increase problems of damp and associated decay of the building fabric, and possibly create health risks for the occupants.

1.3 Thermal mass

Solid walled buildings, particularly those with thicker walls, have comparatively high thermal capacities so they can absorb heat over time and release it relatively slowly as the surroundings cool down. This is the same principle as a storage heater and can have a significant stabilising effect on the internal environment.

Adding external insulation means little of this heat will be lost to the exterior. This allows a building to maintain a level of warmth over day-night heating and cooling cycles, improving human comfort and potentially reducing overall energy use. Internal insulation, whilst reducing short-term heat losses to the exterior will isolate the internal environment from the benefits of much of this thermal mass.

In summer, when strong sun can cause overheating, the thermal mass of the walls cools the interior by absorbing excess heat during the day and releasing it slowly during the night. This helps reduce the need for air conditioning or mechanical cooling.



Figure 2
Hard cement pointing has damaged these soft permeable bricks as moisture has not been able to easily evaporate through the mortar joints.
© Philip White.

1.4 Building context

Location, aspect, and the differing exposure of individual elevations to direct sunlight and wind driven rain have important influences on a building's condition and performance which need to be taken into account when making alterations.

Different parts of a building are affected by very different micro-climates. For example, north facing elevations can be subject to prolonged damp, as they do not receive the benefit of a drying sun and are usually sheltered from drying winds. However, they receive little driving rain from the prevailing south-westerly winds, so conditions are more stable over time. This often means that north-facing walls deteriorate less than south and south-west facing walls which tend to suffer from accelerated rates of decay caused by fluctuations in temperature and regular wetting and drying cycles.

Each building's exposure to the elements is as much influenced by the proximity and position of surrounding buildings and its own projections and extensions as by the exposure of the site.



Figure 3
A cement render has been added to the stone wall of this church which has caused significant damp problems as the render has altered the permeability of the wall.
© Robert Gowing.

For example, an identical terrace of houses can be affected by quite varying levels of exposure and shelter. Such complex variations in microclimate would ideally need to be taken into account in the design of any scheme for adding insulation.

1.5 Wall condition

If a wall suffers from prolonged damp then a number of problems can occur such as:

- decay in timbers in contact with the masonry
- deterioration of the external fabric of the wall due to freezing and thawing
- movement and crystallisation of salts
- movement of tars and other chemicals through the walls, causing staining at the surface
- growth of mould on the inside surfaces of walls
- corrosion of metallic compounds in contact with, or buried within, the wall

Before making any improvements, it is therefore important to understand how solid walled buildings 'manage' the movement of water, in both vapour and liquid form. This is not only complex in itself, but may also be affected by the presence of soluble salts (see [section 1.6](#)).

Most insulation systems are designed and developed solely to limit heat loss and to avoid interstitial condensation from water vapour generated internally. They do not take account of how they affect the movement of moisture and salts already in a traditional wall. So they can easily:

- exacerbate existing problems
- create new problems, such as the displacement of damp and salts and the decay of timbers in contact with the walls
- create health risks for the occupants, for example from mould growth
- be affected by the moisture, reducing their performance and sometimes failing entirely

Where walls have been damp for a long period of time it can take years for them to dry out. The selection and design of insulation must take account of the drying-out process, both before and after installation, and the presence of residual damp and salts.

1.6 Salts

Buildings without a damp-proof course can be prone to damp and salt contamination, particularly at low level, where ground salts are carried in solution. Salts are also commonly found around fireplaces and chimney breasts where they originated as by-products of combustion. They can also originate from a previous use of a building such as from animal excrement and storage of fertilisers in agricultural buildings. Salts may also have been present in the original building materials (stone or aggregate extracted from marine environments) or from the use of chemicals such as caustic soda to remove paint. In some old buildings bricks were under-fired leaving a concentration of salts.

Many of these salts are 'hygroscopic', that is they have an affinity for water and so exacerbate the problems of damp by attracting moisture out of the air leading to the phenomenon of surfaces feeling 'clammy' to the touch. They may also re-crystallise at drying faces with changing moisture levels, and the related expansion within the pores can very effectively turn sound masonry into powder. The interface between existing walls and added insulation can be susceptible to cycles of evaporation, condensation and salt crystallisation. As such locations are hidden from view; major deterioration may have taken place before anybody becomes aware that there is a problem. Unfortunately salts are notoriously difficult to effectively remove from porous building materials such as brickwork, masonry and plasters.



Figure 4
Damp walls can be prone to salt contamination.
© Tobit Curteis Associates.

2 Solid Wall Insulation

Insulation may be added to existing solid walls either externally or internally, but the physical effects on both the building fabric and the internal environment can be very different. This is explored in more detail in the following sections.

2.1 Cost-effectiveness

The necessity to achieve sound detailing to perimeters and openings can significantly add to the initial base cost of both external and internal insulation and may significantly reduce its overall cost-effectiveness as the financial payback is correspondingly long. Full payback periods are typically 30 years or more, but they will inevitably vary depending on particular circumstances.

In the majority of cases it may not be worth considering the insulation of external walls until the full range of easier and more immediately rewarding upgrades have been carried out. These would include actions such as repairing and draught-stripping windows and doors; insulating roofs and suspended ground floors, and upgrading services. Most of these upgrades will also have considerably less impact on the character and significance of historic buildings.

2.2 Impermeable materials

Practical experience of the repair and conservation of historic buildings shows that the introduction of materials and systems that do not maintain permeability can seriously exacerbate existing problems and or create new ones. Examples of impermeable materials and systems which could give rise to problems include:

- closed cell and extruded plastic insulation
- plastic vapour barriers
- cement or acrylic based renders
- cement pointing
- plastic based external wall paints
- vinyl wallpaper

Any of these used on an external wall can trap moisture within the wall and lead to damp and decay, as well as making the walls feel cold and 'clammy'. Installed on the inside, they may do less damage to the building fabric itself, but will negate its ability to buffer moisture levels in the internal air. Both of these can significantly reduce comfort for people using the building, who tend to try to compensate by turning the heating up, thus wasting energy.

Clearly, if the walls are already damp before installing insulation these effects will be exacerbated. Under these circumstances it is particularly important to allow walls to 'breathe' in order to dry to the outside as effectively as possible. Drying to the inside is significantly less effective, and may be unpleasant for users of the building.

2.3 Thermal bridges

Whenever insulation is added to an existing building there is a danger of creating thermal bridges at critical junctions where full coverage may be interrupted. When wall insulation is added these weak points are typically at window and door reveals, but with internal insulation they may also be formed at the points where the floor structure meets external walls.

Areas left with reduced or no insulation coverage will not only be colder, but will also attract relatively more condensation because the majority of other surfaces are warmer and can no longer share the load. The result can be severe local decay, particularly to timber and finishes. For example, the ends of floor joists embedded in the external walls are at increased risk of decay from condensation.

Great care needs to be taken to ensure adequate detailing around window and door openings to avoid potential thermal bridges, and this can significantly increase the overall cost. The necessary level of detailing can be very difficult to incorporate in certain circumstances such as bay windows or decorative corbelled eaves, in which case, depending on the potential severity of the consequences, it may even be better not to install insulation at all.

3 External Wall Insulation

Most external insulation systems comprise an insulation layer fixed to the outside of the existing wall with a protective render or cladding installed on top to protect the insulation from the weather and possible mechanical damage (impact or abrasion).

3.1 Physical adaptation of the building

The increased depth of wall created by an external render or insulation system will often require adaptation to the roof and wall junctions, around window and door openings and the repositioning of rainwater down-pipes and any services fixed to the outside of the building. These alterations may require scaffolding access and possibly a temporary cover to reduce the risk of water penetration during the work.

3.2 Changes in the appearance and character of a building

External insulation will significantly alter a building's appearance, even if it is already rendered. Even then, decorative architectural features such as cornicing, string courses and window surrounds will also be affected. Even where the elevations are quite plain, simple alterations such as the deepening of window and door reveals and the alteration of the eaves

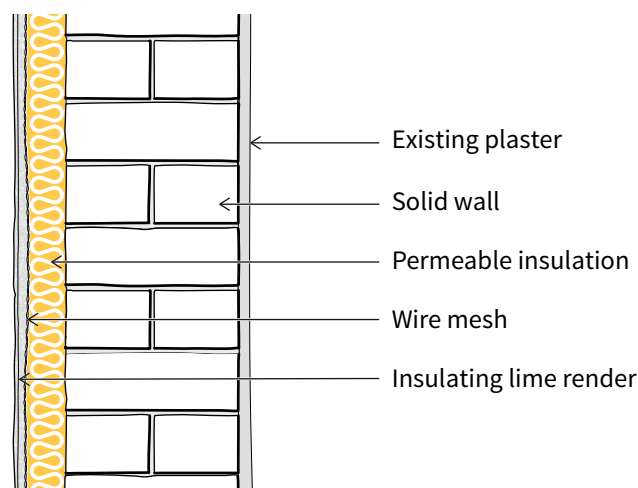


Figure 5: Solid wall - External insulation

This shows a permeable solution with an insulation such as hemp-lime or wood-fibre batts fixed to the masonry and finished with a permeable lime render.

lines can markedly alter a building's appearance. In many cases it will be necessary to actually relocate windows and doors further forward in the overall wall thickness in order to minimise the danger of creating cold bridges at the reveals.

Planning permission will be required for external insulation if the building is listed or in a conservation area. For listed buildings, listed building consent will also be required. Under certain circumstances external wall insulation can be classed as permitted development but the local planning authority should be consulted before any work commences.

3.3 Changes in moisture movement within the wall

It is important that the insulation and protective finish installed externally should have low vapour resistance in order to retain the necessary 'breathability', and allow moisture to evaporate away harmlessly. A useful rule of thumb is that all layers of an insulated solid wall should become progressively more permeable from the interior to the exterior. Whilst it is important to protect external insulation from rain, this should not be done in any way that will trap moisture from within the fabric or from the ground within the solid wall material.

3.4 Materials

For traditional buildings with highly permeable external walls, the need to prevent impermeable layers precludes the use of modern closed-cell foam and other plastic-based insulations, as well as the use of protective finishes which bar moisture vapour movement. As most suitable external insulations will also need to be protected from external rain and from mechanical damage, external insulation should normally be considered as a two-component system where all layers need to work together in harmony.

Useful materials for the external insulation itself include:

- Hemp-lime composites
- Mineral wool
- Wood-fibre panels

All these insulation materials need to be protected from both the weather and mechanical damage, although to differing degrees. Suitable moisture-permeable finishes include:

- Lime renders
- Rain-screen cladding (tile hanging etc) with lapped joints

Materials which can be used as a single coat are available, such as insulating lime renders containing expanded vermiculite, but these tend to give significantly lower insulating values. They can, however, sometimes be applied in circumstances where other types of external insulation would be detrimental to the character of a historic building.

If impermeable 'vapour closed' insulation systems are being used then careful detailing and quality control on site is vital to prevent moisture finding its way between the external wall and the insulation layer. Such systems often depend on mastic sealants which can have a limited lifespan.

4 Internal Wall Insulation

Internal wall insulation is usually applied directly to the inner face of the external wall and then a finish is applied to the room side. Rigid insulation boards can often be fixed directly to the wall face itself, and then the finish applied to conceal them without any additional structure. In its most convenient form, plasterboard can be obtained with a factory-applied insulation backing which can be fixed to the inner face of the wall, often on battens providing a small air gap. Although such systems alone do not offer very great thermal performance they can significantly reduce radiant heat loss and energy use.

For larger thicknesses of insulation, rigid or non-rigid insulating materials can be installed between timber studs or battens fixed to the wall with the new internal finish applied to the timber structure. Occasionally, the structure and insulation may be erected as a separate inner leaf, with a ventilated cavity between the insulation and the original wall. In all cases it is necessary to carefully consider the control of vapour from the warm internal air entering and condensing on the cold side of the insulation, or within vulnerable parts of the external solid wall.

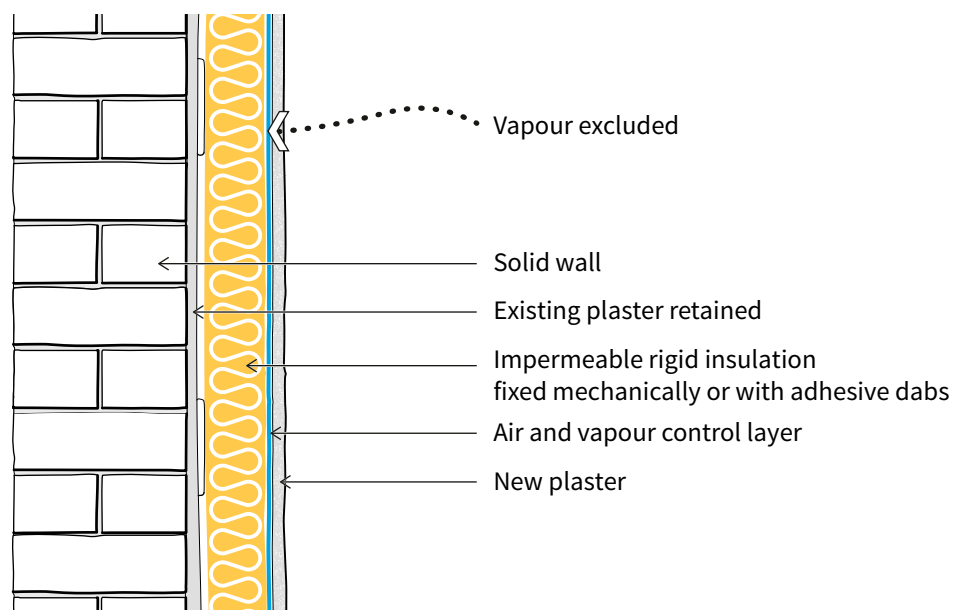


Figure 6: Solid wall – internal insulation

A rigid non-permeable insulation is shown here fixed either with adhesive dabs or mechanically fixed. A vapour control layer is added to the room side face before plastering. Care needs to be taken to make

sure this layer is not punctured by fittings or fixtures otherwise water vapour could find its way into the construction and condense on the cold side of the insulation.

4.1 Physical adaptation of the building

As with external insulation, care needs to be taken with the design and installation of internal insulation at critical details in order to avoid cold bridging, particularly at the reveals of windows and doors and wall/floor junctions. It is also often necessary to relocate services (radiators and associated pipe runs, electric power points and light switches) as well as making adjustments to skirting boards and door architraves.

The construction of a separate insulated inner leaf could include ventilation to the cavity. However, there is a risk that there will be insufficient air movement within the cavity and any vents could alter the character or appearance of the building. There is no point in ventilating such a cavity to the inside of the building, as the air movement will simply by-pass the insulation, rendering it ineffective.

Thick, high-performing internal insulation installations will often significantly reduce the floor area of rooms and corridors, sometimes to the extent that they cannot be used as before.

4.2 Changes in the appearance and character of a building

Significant internal features such as plaster cornices, picture rails, skirting boards and door architraves may all be affected by internal wall insulation. They will inevitably be either concealed or disturbed to accommodate the insulation. Although it is normally possible to replicate such details on the inner face of the new insulation, the effect of revised room proportions on the design of adjacent wall finishes needs to be carefully considered at the design stage, as the side walls of an insulated room will become shorter.

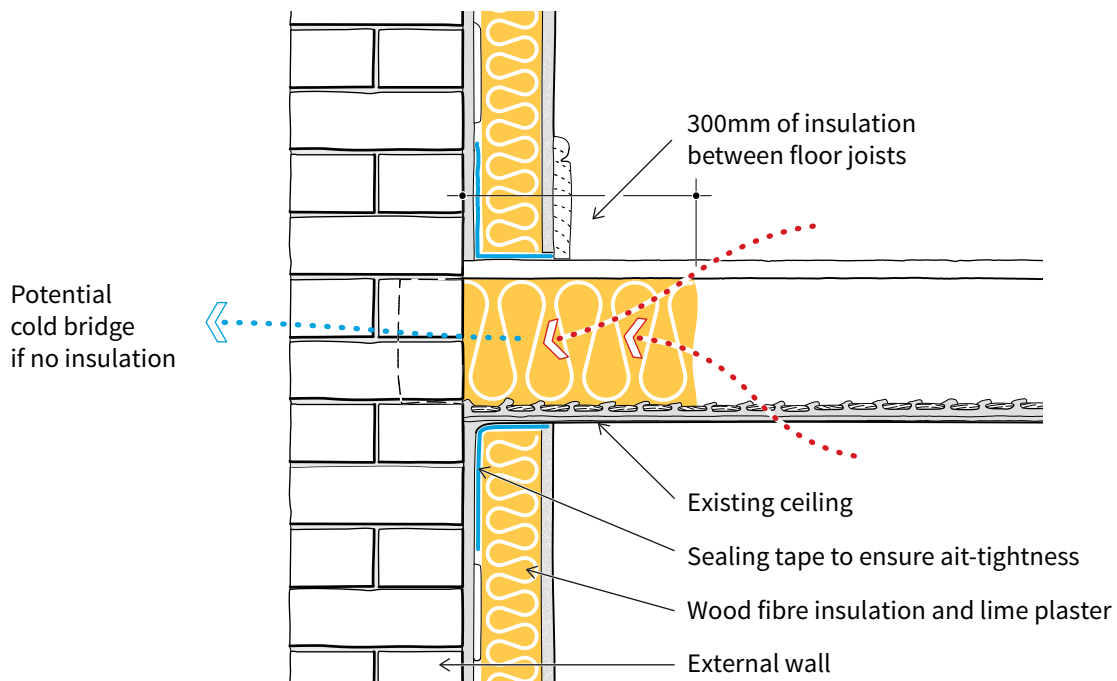


Figure 7: Thermal break at floor junction

To avoid a thermal break at a floor junction insulation should be added within the perimeter of the floor zone. It is also important to seal insulation at junctions with the ceiling to maintain air-tightness.

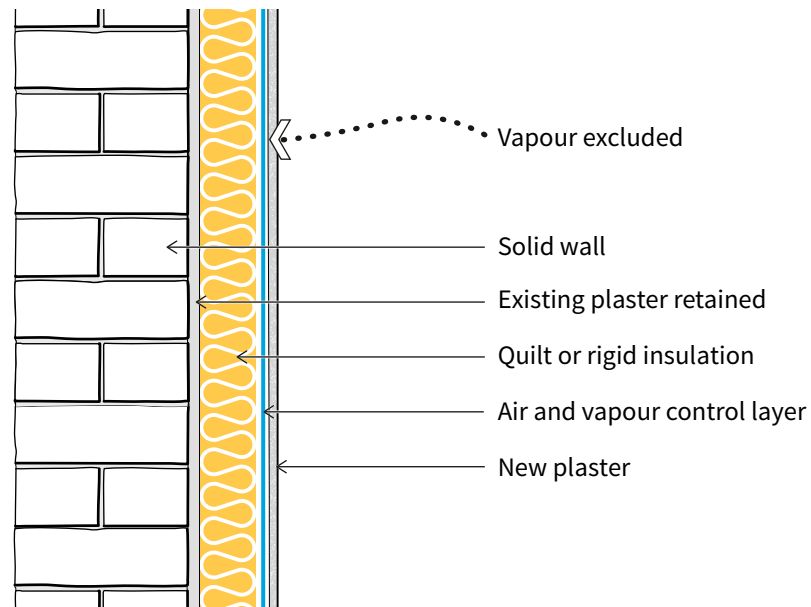
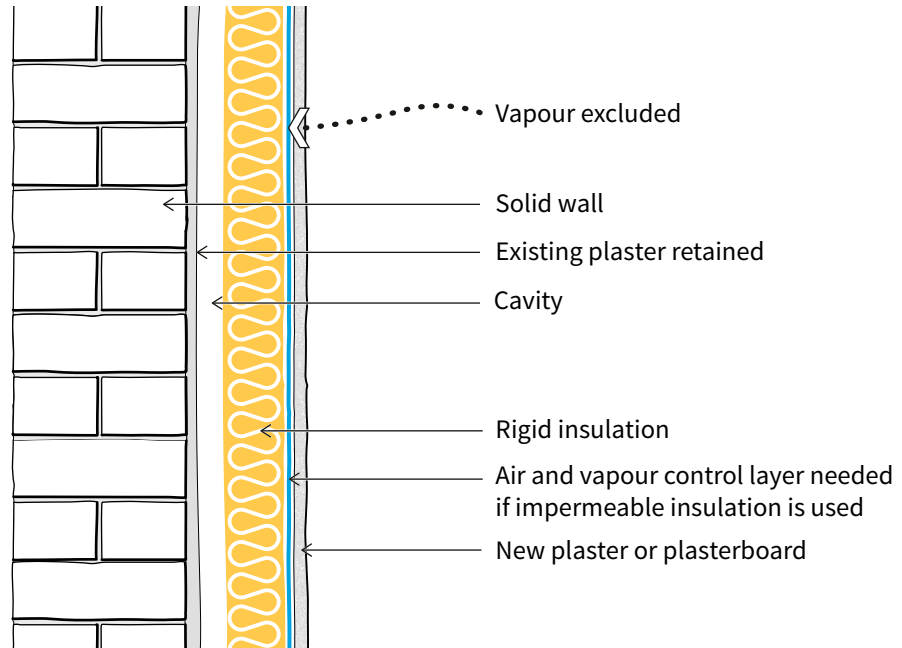


Figure 8 (top): Solid wall – Internal insulation with cavity

The insulation here is kept entirely separate from the external wall by means of a cavity. If impermeable insulation is used then a vapour control layer would still be recommended as the air movement within the cavity might be quite minimal. With this arrangement the benefits of the wall's thermal mass are lost.

Figure 9 (bottom): Solid wall – Internal insulation with timber battens

The use of timber battens can allow other types of insulation to be used other than rigid insulation. In some proprietary systems the battens have insulation bonded to them to minimise cold bridging through the timber. Quilt insulation can be held in place between the battens or materials such as cellulose can fill the cavity. A vapour control layer is shown in this detail as the insulation is non-permeable.

The disturbance to the internal appearance can be compounded by the need to extend insulation back from the external wall onto party walls, other internal walls, floors and ceilings to reduce the risk of thermal bridging.

In listed buildings, consent will be required for any internal alterations that affect the appearance and character, including any materials, details and finishes of historic or architectural interest. In many cases this may make the installation of insulation unacceptable.

4.3 Changes in moisture movement within the wall

In order to prevent condensation occurring on the cold side of internal 'vapour-closed' insulation it is necessary to separate it effectively from the warm moisture-bearing air of the building's interior. This will require the use of an effective vapour control layer. Alternatively, a 'vapour open' permeable system such as wood-fibre can be used where no vapour control layers are needed.

Effective vapour control is very difficult to achieve in practical terms. Air and vapour control layers are positioned on the warm side of the insulation behind the new finish. As a consequence these membranes are easily damaged by building users

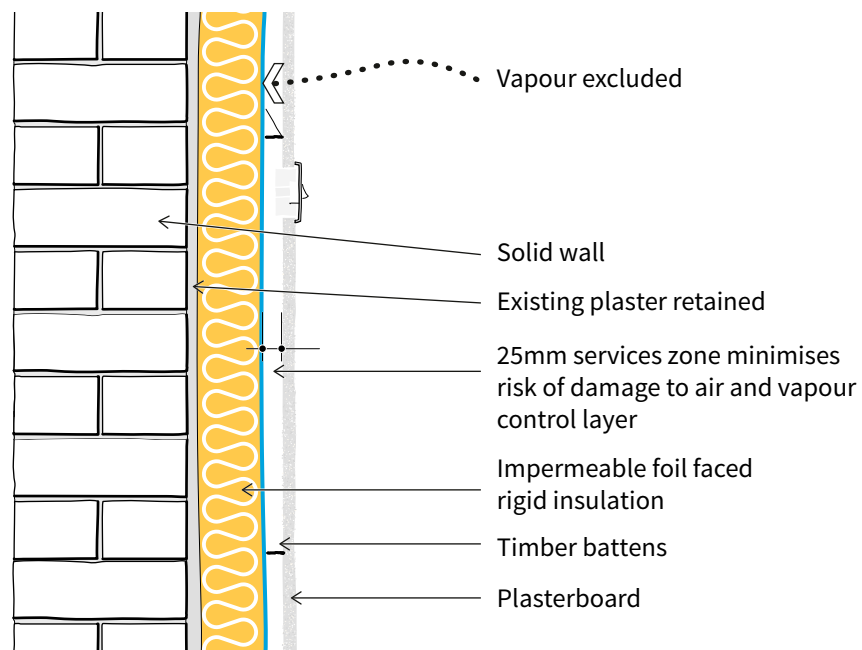


Figure 10: Solid wall – Internal insulation with services zone

An impermeable foil back rigid insulation board is shown here with battens fixed over. These provide a fixing for the plasterboard without puncturing the foil-face as well as providing a services zone.

making fixings in walls or modifying electrical fittings. They can also be punctured during the construction process itself. All penetrations can allow moisture vapour through, which can condense either within or adjacent to the insulation, potentially causing rot and decay in a hidden location. Closed-cell foams are inherently vapour-impermeable, but are vulnerable to vapour penetration at the joints.

Both forms of vapour control are also vulnerable at the perimeter, particularly in a traditional permeable structure, where moisture can by-pass the physical vapour barrier through adjoining walls and floors. However, many of these problems can be overcome by using insulation systems such as wood-fibre that are hygroscopic and 'vapour open'.

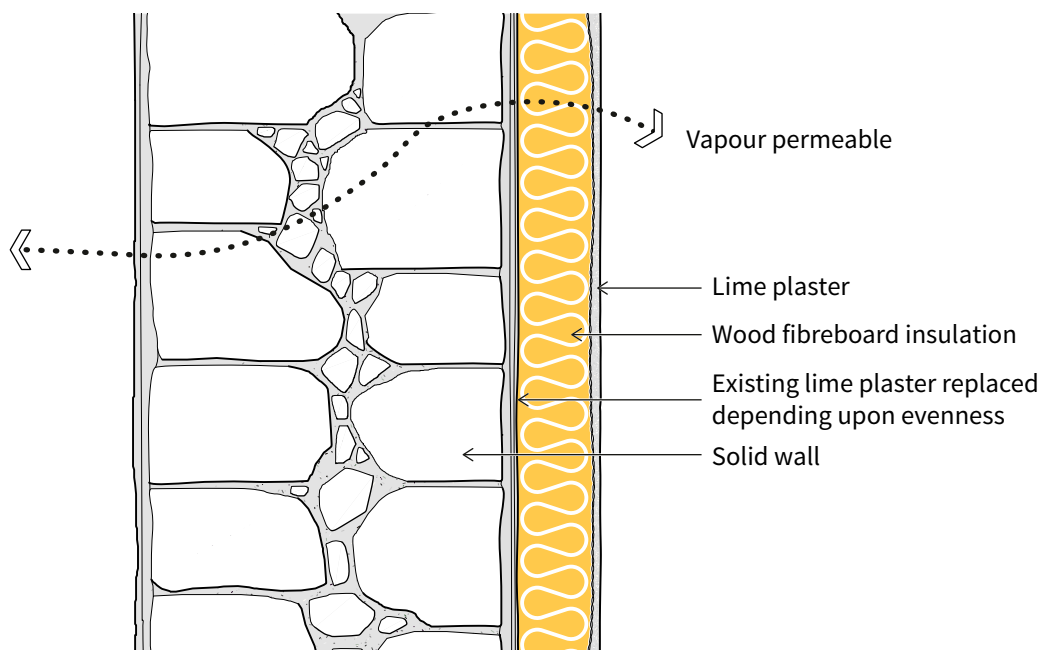


Figure 11: Internal solid wall insulation (with no vapour control layer)

This shows a fully permeable insulation system using wood-fibre board and lime plaster. A new lime plaster may need to be added to the existing wall to provide an even surface if the existing plaster surface is particularly uneven or is made of gypsum.

4.4 Materials

Almost any insulation material available can be used internally, subject to proper control of vapour and careful isolation from sources of any dampness. The full range of possible internal finishes can also be applied, either to copy the original or to introduce a new design.

New insulation products are continually being developed, particularly those that have a very minimal thickness (around 10mm). The benefits of such products to reduce overall energy consumption can be small and relatively expensive. However, what they can do is make a room feel more comfortable by reducing radiant heat loss, raising the surface temperature of the walls and possibly reducing the risk of condensation occurring on the decorated surface.

In all cases, it is important to understand the likely effects of proposals at the design stage in order to avoid damage to both new and valuable historic building fabric.



Figure 12 (top)

Permeable insulation such as this wood-fibre board are compatible with the 'breathable' nature of traditional construction.

Figure 13 (bottom)

Closed cell insulation bonded to plasterboard.

5 Where to Get Advice

This guidance forms part of a series of thirteen documents which are listed below, providing advice on the principles, risks, materials and methods for improving the energy efficiency of various building elements such as roofs, walls and floors in older buildings.

This series forms part of a wider comprehensive suite of guidance providing good practice advice on adaptation to reduce energy use and the application and likely impact of carbon legislation on older buildings.

The complete series of guidance is available to download from the Historic England website:
[HistoricEngland.org.uk/energyefficiency](https://www.historicengland.org.uk/energyefficiency)

Roofs

- *Insulating pitched roofs at rafter level*
- *Insulating pitched roofs at ceiling level*
- *Insulating flat roofs*
- *Insulating thatched roofs*
- *Open fires, chimneys and flues*
- *Insulating dormer windows*

Walls

- *Insulating timber-framed walls*
- *Insulating solid walls*
- *Insulating early cavity walls*

Windows and doors

- *Draught-proofing windows and doors*
- *Secondary glazing for windows*

Floors

- *Insulating suspended timber floors*
- *Insulating solid ground floors*

For information on consents and regulations for energy improvement work see [historicengland.org.uk/advice/your-home/saving-energy/consent-regulations/](https://www.historicengland.org.uk/advice/your-home/saving-energy/consent-regulations/)

5.1 Contact Historic England

East Midlands
2nd Floor, Windsor House
Cliftonville
Northampton NN1 5BE
Tel: 01604 735460
Email: eastmidlands@HistoricEngland.org.uk

East of England
Brooklands
24 Brooklands Avenue
Cambridge CB2 8BU
Tel: 01223 582749
Email: eastofengland@HistoricEngland.org.uk

Fort Cumberland
Fort Cumberland Road
Eastney
Portsmouth PO4 9LD
Tel: 023 9285 6704
Email: fort.cumberland@HistoricEngland.org.uk

London
1 Waterhouse Square
138-142 Holborn
London EC1N 2ST
Tel: 020 7973 3700
Email: london@HistoricEngland.org.uk

North East
Bessie Surtees House
41-44 Sandhill
Newcastle Upon Tyne NE1 3JF
Tel: 0191 269 1255
Email: northeast@HistoricEngland.org.uk

North West
3rd Floor, Canada House
3 Chepstow Street
Manchester M1 5FW
Tel: 0161 242 1416
Email: northwest@HistoricEngland.org.uk

South East
Eastgate Court
195-205 High Street
Guildford GU1 3EH
Tel: 01483 252020
Email: southeast@HistoricEngland.org.uk

South West
29 Queen Square
Bristol BS1 4ND
Tel: 0117 975 1308
Email: southwest@HistoricEngland.org.uk

Swindon
The Engine House
Fire Fly Avenue
Swindon SN2 2EH
Tel: 01793 445050
Email: swindon@HistoricEngland.org.uk

West Midlands
The Axis
10 Holliday Street
Birmingham B1 1TG
Tel: 0121 625 6870
Email: westmidlands@HistoricEngland.org.uk

Yorkshire
37 Tanner Row
York YO1 6WP
Tel: 01904 601948
Email: yorkshire@HistoricEngland.org.uk

This page is left blank intentionally



Historic England

We are the public body that looks after England's historic environment. We champion historic places, helping people understand, value and care for them.

Please contact
customers@HistoricEngland.org.uk
with any questions about this document.

HistoricEngland.org.uk

If you would like this document in a different format, please contact our customer services department on:

Tel: 0370 333 0607
Fax: 01793 414926
Textphone: 0800 015 0174
Email: customers@HistoricEngland.org.uk

Please consider the environment before printing this document

HEAG081
Publication date: v1.0 March 2012 © English Heritage
Reissue date: v1.1 April 2016 © Historic England
Design: Gale & Hayes/Historic England











PATHOLOGY MANAGEMENT SERVICES

ROSE MILL, UNION STREET, MIDDLETON, MANCHESTER M24 6DD

TEL: 0161 643 5330

Web Site: www.pathology-management.co.uk

Email: path.man@hotmail.com

Our Ref.: RFG0046

EEC O2 Ltd
Suite 9
The Green
Fountain Square
Macclesfield
Cheshire
SK10 1JN

MICROBIOLOGY REPORT ON SWABS RECEIVED & TESTED: 29/12/23

Sample Arrival Temperature: Chilled°C

LAB No	SITE	TESTS	RESULT
FMF322	Kitchen Door Sampled: 28/12/23 Time Taken: **:**	Total Viable Count (SOP-MB-001) (Aerobic)	6.3 x 10 ³ cfu/swab
		Enterobacteriaceae (SOP-MB-003)(Presumptive)	6.0 x 10 ¹ cfu/swab
		Moulds (SOP-MB-008)	>1.0 x 10 ⁶ cfu/swab
		Enterococci (SOP-MB-010)	<1.0 x 10 ¹ cfu/swab
		E.coli (SOP-MB-015)(B-glucuronidase positive)	4.0 x 10 ¹ cfu/swab
FMF323	Green Line Sampled: 28/12/23 Time Taken: **:**	Total Viable Count (SOP-MB-001) (Aerobic)	8.1 x 10 ³ cfu/swab
		Enterobacteriaceae (SOP-MB-003)(Presumptive)	<1.0 x 10 ¹ cfu/swab
		Moulds (SOP-MB-008)	2.7 x 10 ² cfu/swab
		Enterococci (SOP-MB-010)	<1.0 x 10 ¹ cfu/swab
		E.coli (SOP-MB-015)(B-glucuronidase positive)	<1.0 x 10 ¹ cfu/swab
FMF324	End Wall Rock Room Sampled: 28/12/23 Time Taken: **:**	Total Viable Count (SOP-MB-001) (Aerobic)	6.3 x 10 ³ cfu/swab
		Enterobacteriaceae (SOP-MB-003)(Presumptive)	1.8 x 10 ² cfu/swab
		Moulds (SOP-MB-008)	6.6 x 10 ² cfu/swab
		Enterococci (SOP-MB-010)	<1.0 x 10 ¹ cfu/swab
		E.coli (SOP-MB-015)(B-glucuronidase positive)	1.0 x 10 ¹ cfu/swab
FMF325	Side Wall Rock Room Sampled: 28/12/23 Time Taken: **:**	Total Viable Count (SOP-MB-001) (Aerobic)	7.7 x 10 ³ cfu/swab
		Enterobacteriaceae (SOP-MB-003)(Presumptive)	2.1 x 10 ² cfu/swab
		Moulds (SOP-MB-008)	8.7 x 10 ² cfu/swab
		Enterococci (SOP-MB-010)	<1.0 x 10 ¹ cfu/swab
		E.coli (SOP-MB-015)(B-glucuronidase positive)	<1.0 x 10 ¹ cfu/swab
FMF326	Behind Loo Sampled: 28/12/23 Time Taken: **:**	Total Viable Count (SOP-MB-001) (Aerobic)	9.5 x 10 ⁴ cfu/swab
		Enterobacteriaceae (SOP-MB-003)(Presumptive)	3.0 x 10 ¹ cfu/swab
		Moulds (SOP-MB-008)	8.6 x 10 ² cfu/swab
		Enterococci (SOP-MB-010)	<1.0 x 10 ¹ cfu/swab
		E.coli (SOP-MB-015)(B-glucuronidase positive)	9.0 x 10 ¹ cfu/swab

*This report will not be reproduced without the approval of Pathology Management Services
before a result denotes this an estimated count of bacteria growth.*

*Validity of results can not be guaranteed when traceability of the swab is not achievable or when the sample time & date exceed the permissible 24hour timeframe.
Such results will be deemed invalid and the report will carry a disclaimer to this effect.*

Samples tested as received on arrival at the laboratory

Authorised by:

D. Andrew BA (Hons) _____ (Proprietor)

T. Rutter BSc (Hons) _____ (Lab Manager)

R. Smith BSc (Hons) _____

(Quality Manager)

Report Date: 03 January 2024