

Sewage Treatment Plant

The proposed Glamping Pods will be connected to one Sewage Treatment Plant.

The Sewage Treatment brochure is attached.



The brochure features the Vortex logo at the top, which consists of a blue circular icon with a white swirl and the text "VORTEX™ WASTEWATER TREATMENT SYSTEM". Below the logo is a cutaway diagram of the treatment tank, showing internal components like a pump, diffusers, and a skimmer. At the bottom left is a blue circular badge that says "Certified to EN12566-3". To the right of the badge is a table with technical specifications.

Electricity Required	Yes
Internal Moving Parts	No
Safe For Discharge To Watercourse	Yes
Average Desludge Interval	12 Months
Average Service Interval	6 - 12 Months
Tank Warranty	10 Years

Your Local Distributor is:

ADVANTAGES

- Excellent effluent quality.
- Simple and reliable operation.
- Excellent build quality.
- Low noise.
- Low electricity demand.
- Easy installation.
- CE marked.
- EN 12566-3 certified.
- Excellent value for money.
- Odourless
- Discharge to ground or watercourse
- Internal Sampling Chamber (no extra chamber to buy & install)

INTRODUCTION


The Vortex is an advanced Activated Sludge Process (ASP) sewage treatment plant.

It is capable of receiving wastewater from buildings not connected to mains drainage and processing it so that only a clear effluent is discharged into the environment.

The Vortex is an eco electric sewage treatment plant. Under normal use the air blower is only active for 30 minutes in every 45.

The Vortex has been tested and certified to EN 12566-3.

HOW THE SYSTEM WORKS

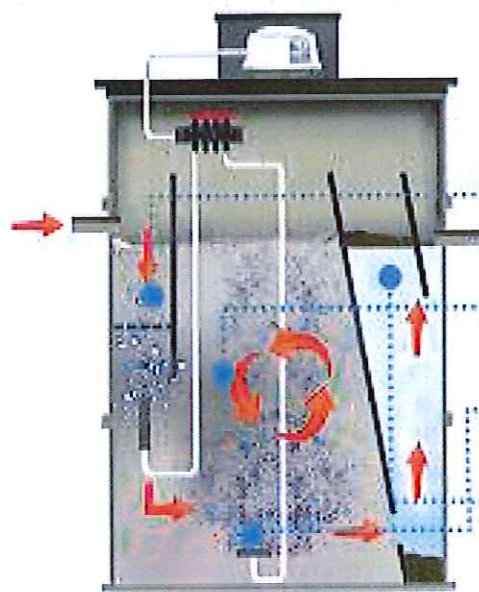

The Vortex Treatment Process

Unlike most sewage treatment plants the Vortex is designed to treat both the solid and liquid components of wastewater. It does this by using a combination of coarse and fine air bubbles.

Wastewater from the building enters the Vibro Screens. Here coarse air bubbles are used to physically break down solid matter and form a mixed liquor with the water.

The mixed liquor flows into the Aeration Chamber. A bacterial culture is present in the Aeration Chamber which digests the pollutants in the wastewater.

The bacterial culture must have an oxygen supply. This is supplied by an external air blower that supplies air to a fine bubble diffuser at the base of the tank.

The mixed liquor then flows into the Clarification Chamber. Here it is able to separate into clear, treated effluent and sludge. The clear effluent is able to flow past the screen profile and out of the tank.

Tank cross section for graphical representation only

THE SLUDGE MANAGEMENT SYSTEM

All Activated Sludge Process (ASP) sewage treatment plants produce sludge as part of the treatment process. The Vortex's Sludge Management System is one of the elements that make it an advanced ASP.

The sludge is composed of partially digested solid matter. The Vortex is able to return the sludge back to the Aeration Chamber for further digestion by the bacteria.


The recycling of sludge back to the Aeration Chamber gives the bacteria a food supply even when there is little or no wastewater coming from the building. This makes the Vortex better able to handle low occupation sites than other ASP sewage treatment plants.

This recycling of sludge is done without the use of electrical or mechanical components in the tank.

In the Clarification Chamber sludge accumulates at the bottom (settled sludge) and top (floating sludge) of the tank.

Air from the blower is pumped from the regulator to two sludge return pipes.

The Settled Sludge Return (SSR) pipe at the base is created in a cyclonic vacuum that sucks the sludge from the top and bottom of the Clarification Chamber back to the Aeration Chamber.

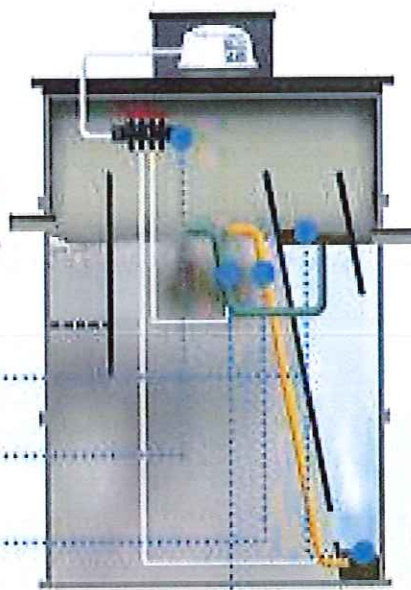

AUTOMATIC FSR KIT

The automatic FSR Kit enables the Vortex to recycle and manage the floating sludge on a daily basis.

This reduces the need for the owner to manually manage the sludge build up in the tank.

No other ASP sewage treatment plant has this ability to manage its own sludge.

All Vortex sewage treatment plants are manufactured assuming an Automatic FSR Kit will be fitted. The tank can be easily converted back to manual without the need to buy additional components.

PERFORMANCE

The Vortex has been designed to meet the UK Royal Commission Standard for effluent of:

BOD ₅	20 mg / L
Suspended Solids	30 mg / L
Ammonia	20 mg / L

Due to the Vortex's unique design it far exceeded the above standard during EU testing and achieved the following average effluent quality:

BOD ₅	7.4 mg / L
Suspended Solids	15.2 mg / L
Ammonia	0.4 mg / L

TECHNICAL DETAILS

Model	FE	Tank Diameter (m)	In Ground Depth (m)	Inlet Invert (m)*	Outlet Invert (m)†	Power (kW)
Vortex 4	4	1.350	2.000	0.550	0.720	0.08
Vortex 6	6	1.400	2.000	0.650	0.720	0.08
Vortex 8	8	1.700	2.000	0.650	0.720	0.10
Vortex 10	10	1.800	2.000	0.650	0.720	0.10
Vortex 15	15	1.800	2.250	0.705	0.750	0.15
Vortex 20	20	2.090	2.550	0.803	0.850	0.08 + 0.12
Vortex 30	30	2.340	2.550	0.863	0.900	0.12 + 0.12

† Pump stations available * Other inlet options available

INSTALLATION

The Vortex is easy to install and is suitable for high groundwater sites. When installed on dry sites there is no requirement for concrete.

There are shallow and deep inlet options available for most tanks in the range.

The Vortex is capable of being installed above ground if required. Please contact our office for details on your nearest trained installer.



MAINTENANCE

The Vortex sewage treatment plant requires servicing every six months.

The servicing is done by trained service engineers to ensure that the system functions correctly giving the owner peace of mind.

Please contact our service partner **Sophie Environmental** for details on servicing: www.sophieeservicing.com

CONTACT